Map 1 of 3
Shows 1 thru 21 of 101 proposed lights

SAFETYFirst
▶ PERSONAL ACCOUNTABILITY
▶ ACTIVE CARING
▶ HAZARD RECOGNITION

USP: Add Up Stream Protection, Facility ID, and Blocking Devise Type
USP: Reclosure facility ID 85125205
USP: SCADA Harrisburg Rd @ Sam Dee Rd
USP:
USP: SCADA Newell Substation @ Rocky River Rd and Hood Rd

Safety Reminders / Adverse Conditions
?: Very large busy neighborhood. Watch for pedestrians, vehicles, etc
?:
?:
?:

WZS: Remember "Your Circle of Safety"
WZS: CDOT WATCH 2014 Edition Diagram 4
WZS: Work Area on Shoulder
WZS:
WZS:

REMEMBER: Work zone area conditions may have changed for this job! Everyone is responsible for verifying the above safety information is correct prior to any work being performed each day.

Install: 21 of 101 lights
Punch under 15 driveways

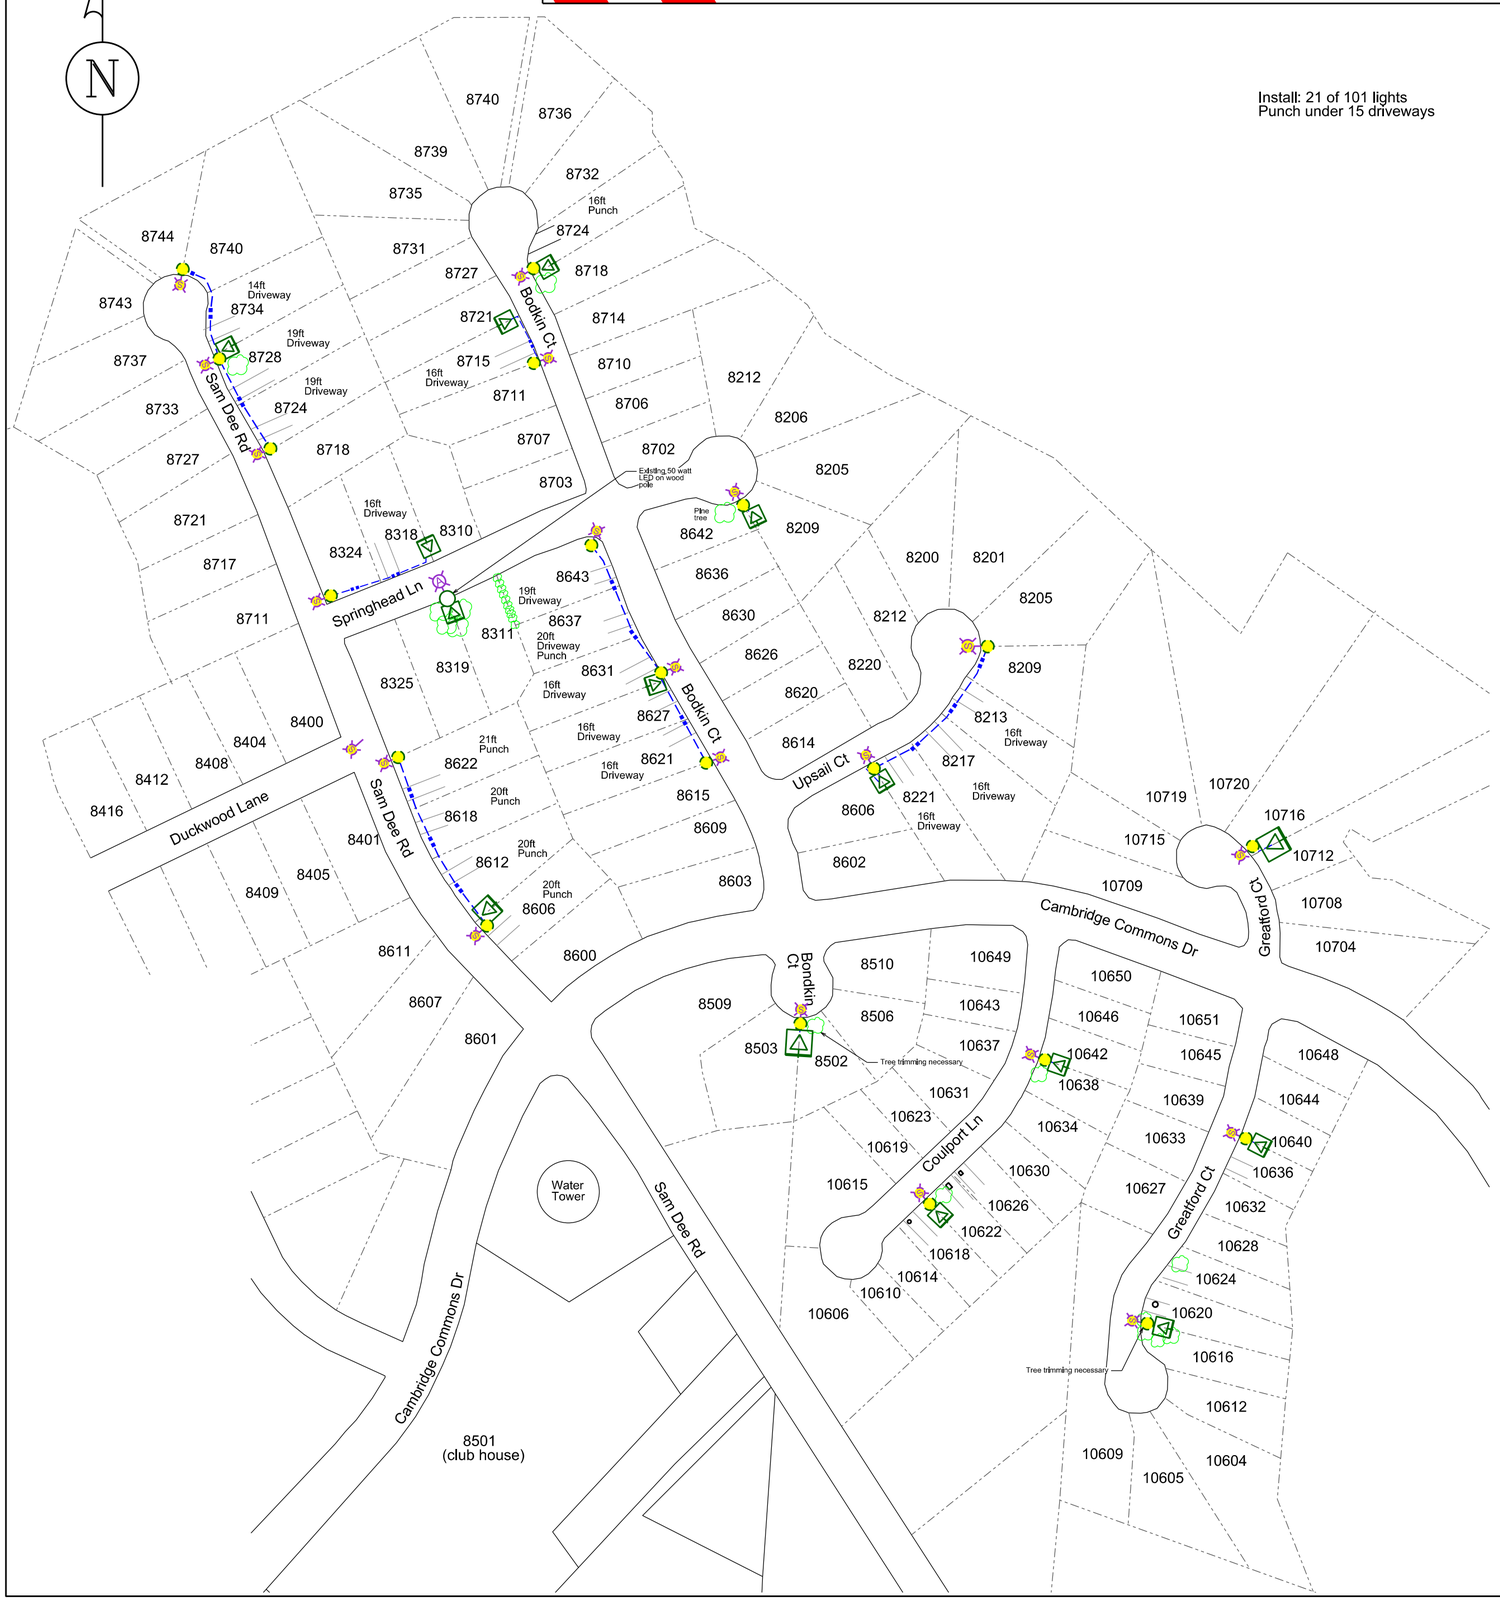

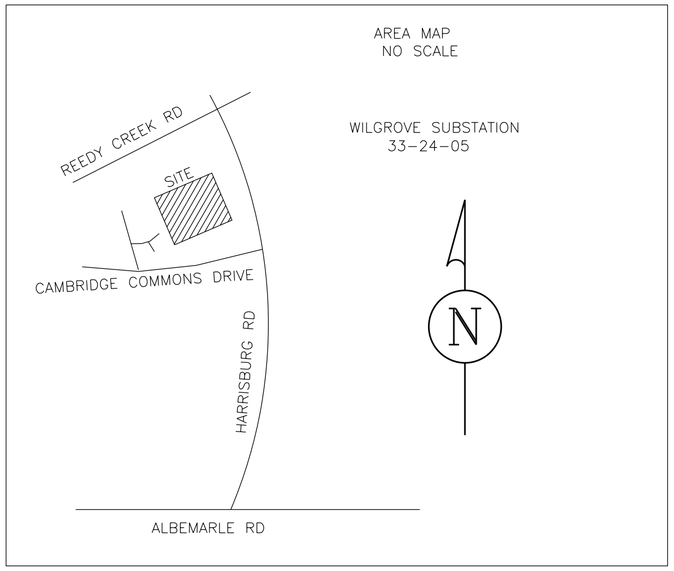

Legend

- Proposed Wood Pole and 70 watt Cobra Head
- Proposed Underground Secondary
- Existing Undergroud Transformer
- Existing Wood Pole
- Existing Street Light
- Tree, Bush, Shrub

Substation Name(s)	SCADA Newell Substation
Circuit ID(s)	01342405
Facility ID(s)	40864119
Work Order Number	6061293
Customer/Contact	Todd Huss
Contact Phone	704-336-4118
Job Site Address	Cambridge Commons Dr.
City	CHARLOTTE
County	MECKLENBURG
State, Zip	NC,28215
Designer	Kenneth Hunter
Designer Phone	704-395-4430

Double click to add addtional notes and details to drawing,

DUKE ENERGY.

Sheet 1 of 3
Scale = N/A