




USP: Add Up Stream Protection, Facility ID, and Blocking Devise Type
 USP: Reclosure facility ID 85125205
 USP: SCADA Harrisburg Rd @ Sam Dee Rd
 USP:
 USP: SCADA Newell Substation @ Rocky River Rd and Hood Rd



Safety Reminders / Adverse Conditions
 ?: Very large busy neighborhood. Watch for pedestrians, vehicles, etc
 ?:
 ?:
 ?:





WZS: Remember "Your Circle of Safety"
 WZS: CDOT WATCH 2014 Edition Diagram 4
 WZS: Work Area on Shoulder
 WZS:
 WZS:

REMEMBER: Work zone area conditions may have changed for this job! Everyone is responsible for verifying the above safety information is correct prior to any work being performed each day.



Install: 38 of 101 lights
 Punch under 13 driveways and 1 sidewalk

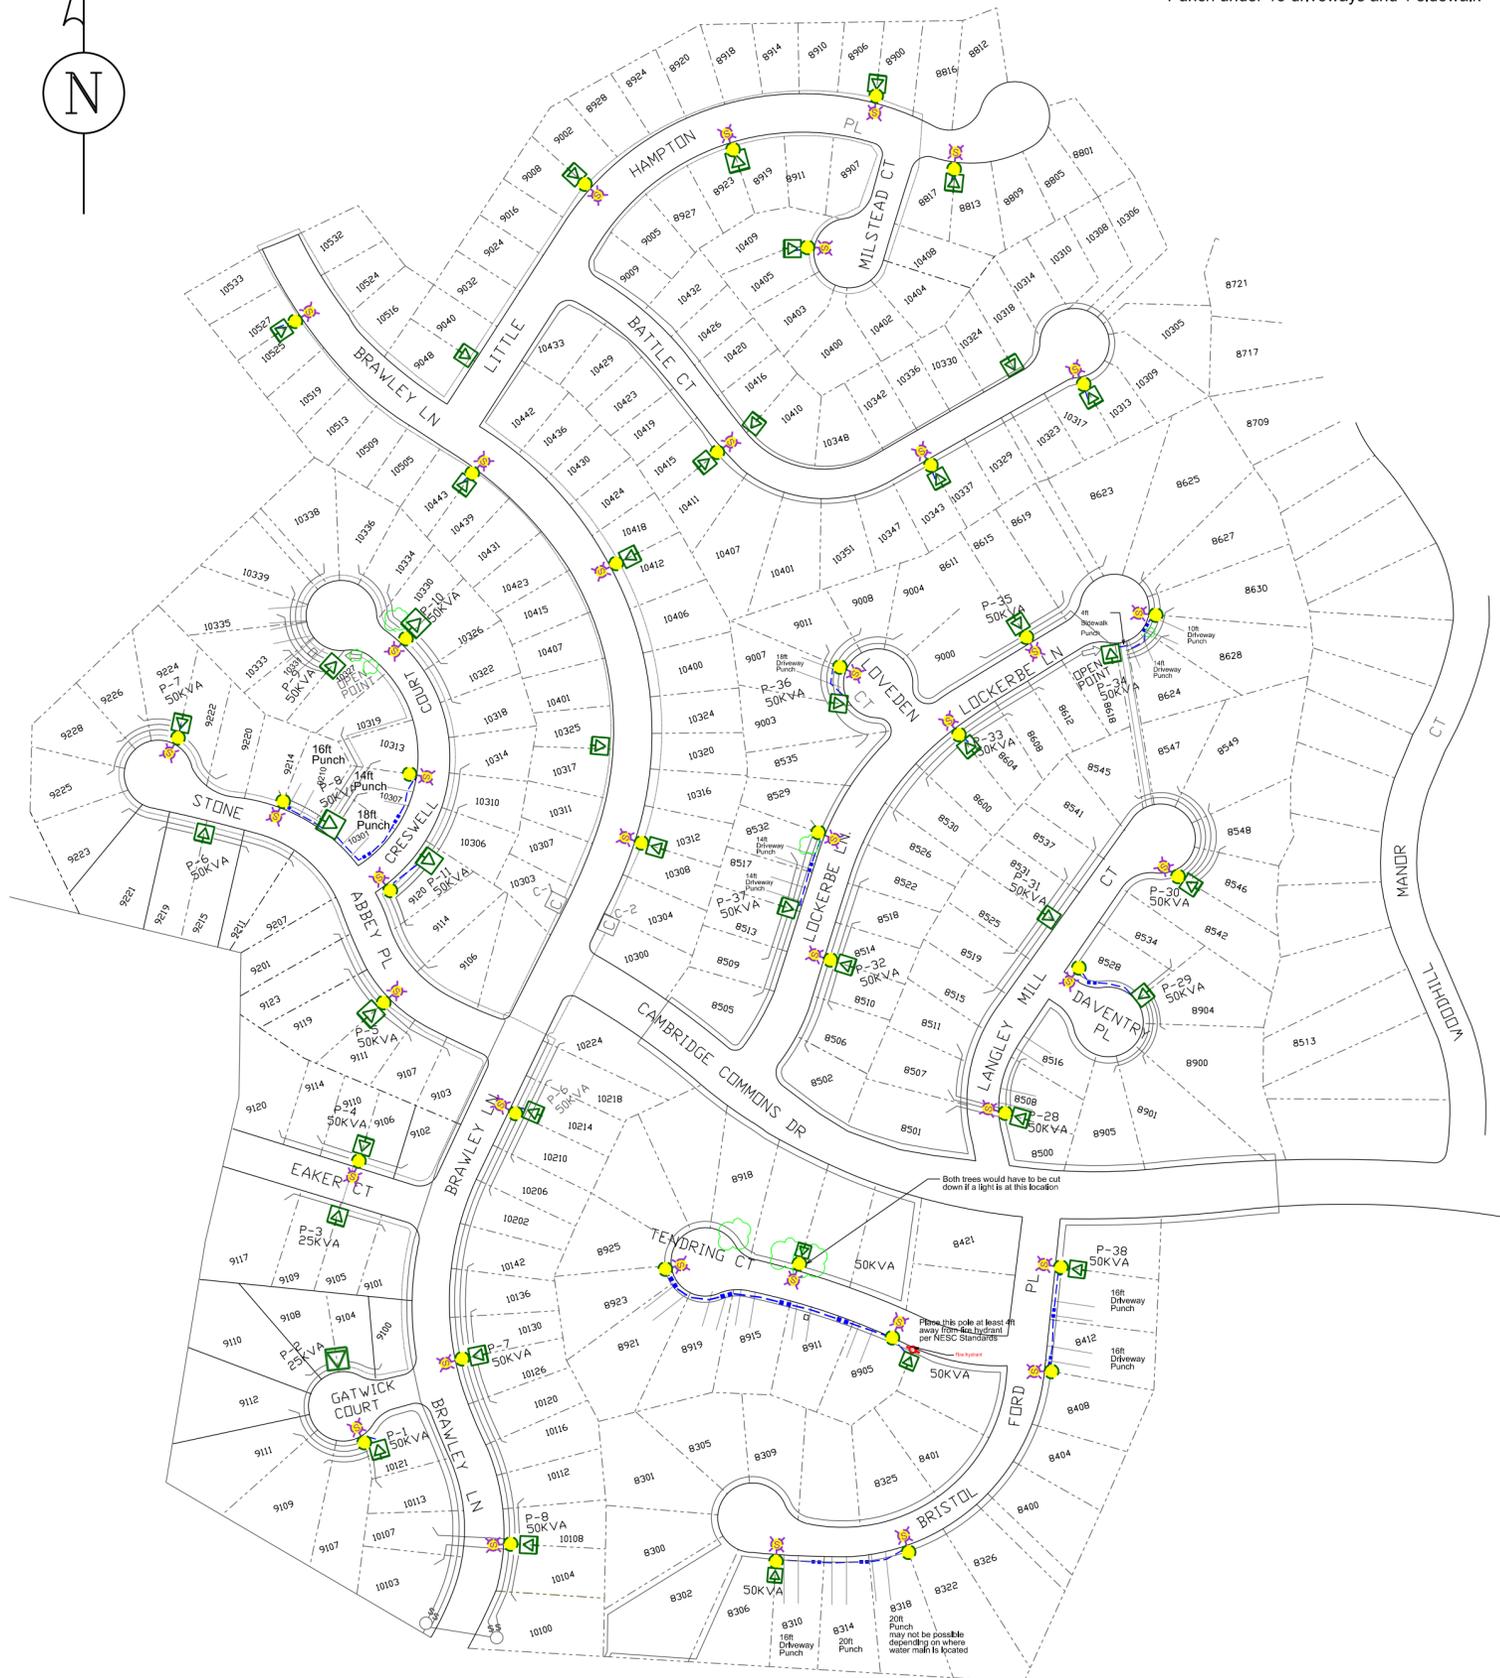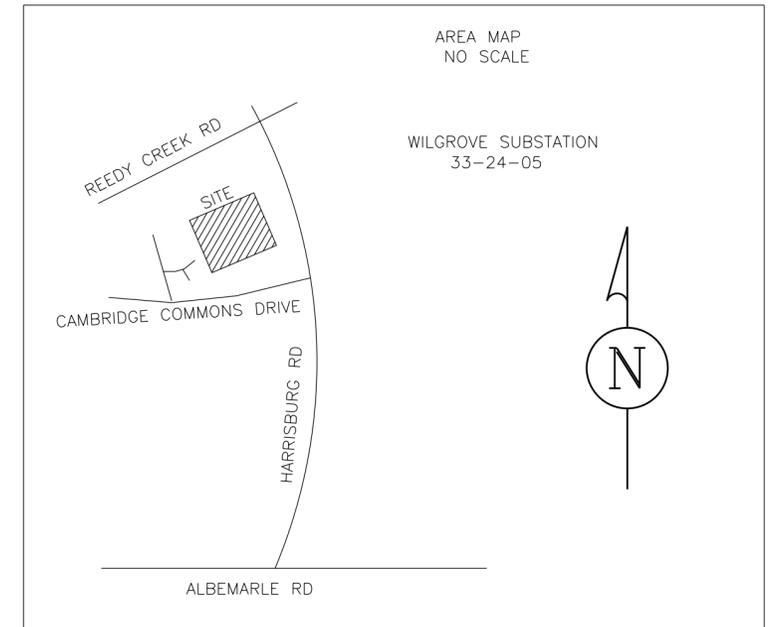

Legend

- Proposed Wood Pole and 70 watt Cobra Head
- Proposed Underground Secondary
- Existing Undergroud Transformer
- Existing Wood Pole
- Existing Street Light
- Tree, Bush, Shrub

Substation Name(s)	SCADA Newell Substation
Circuit ID(s)	01342407
Facility ID(s)	40864119
Work Order Number	6061293
Customer/Contact	Todd Huss
Contact Phone	704-336-4118
Job Site Address	Cambridge Commons Dr.
City	CHARLOTTE
County	MECKLENBURG
State, Zip	NC, 28215
Designer	Kenneth Hunter
Designer Phone	704-395-4430
Double click to add additional notes and details to drawing.	