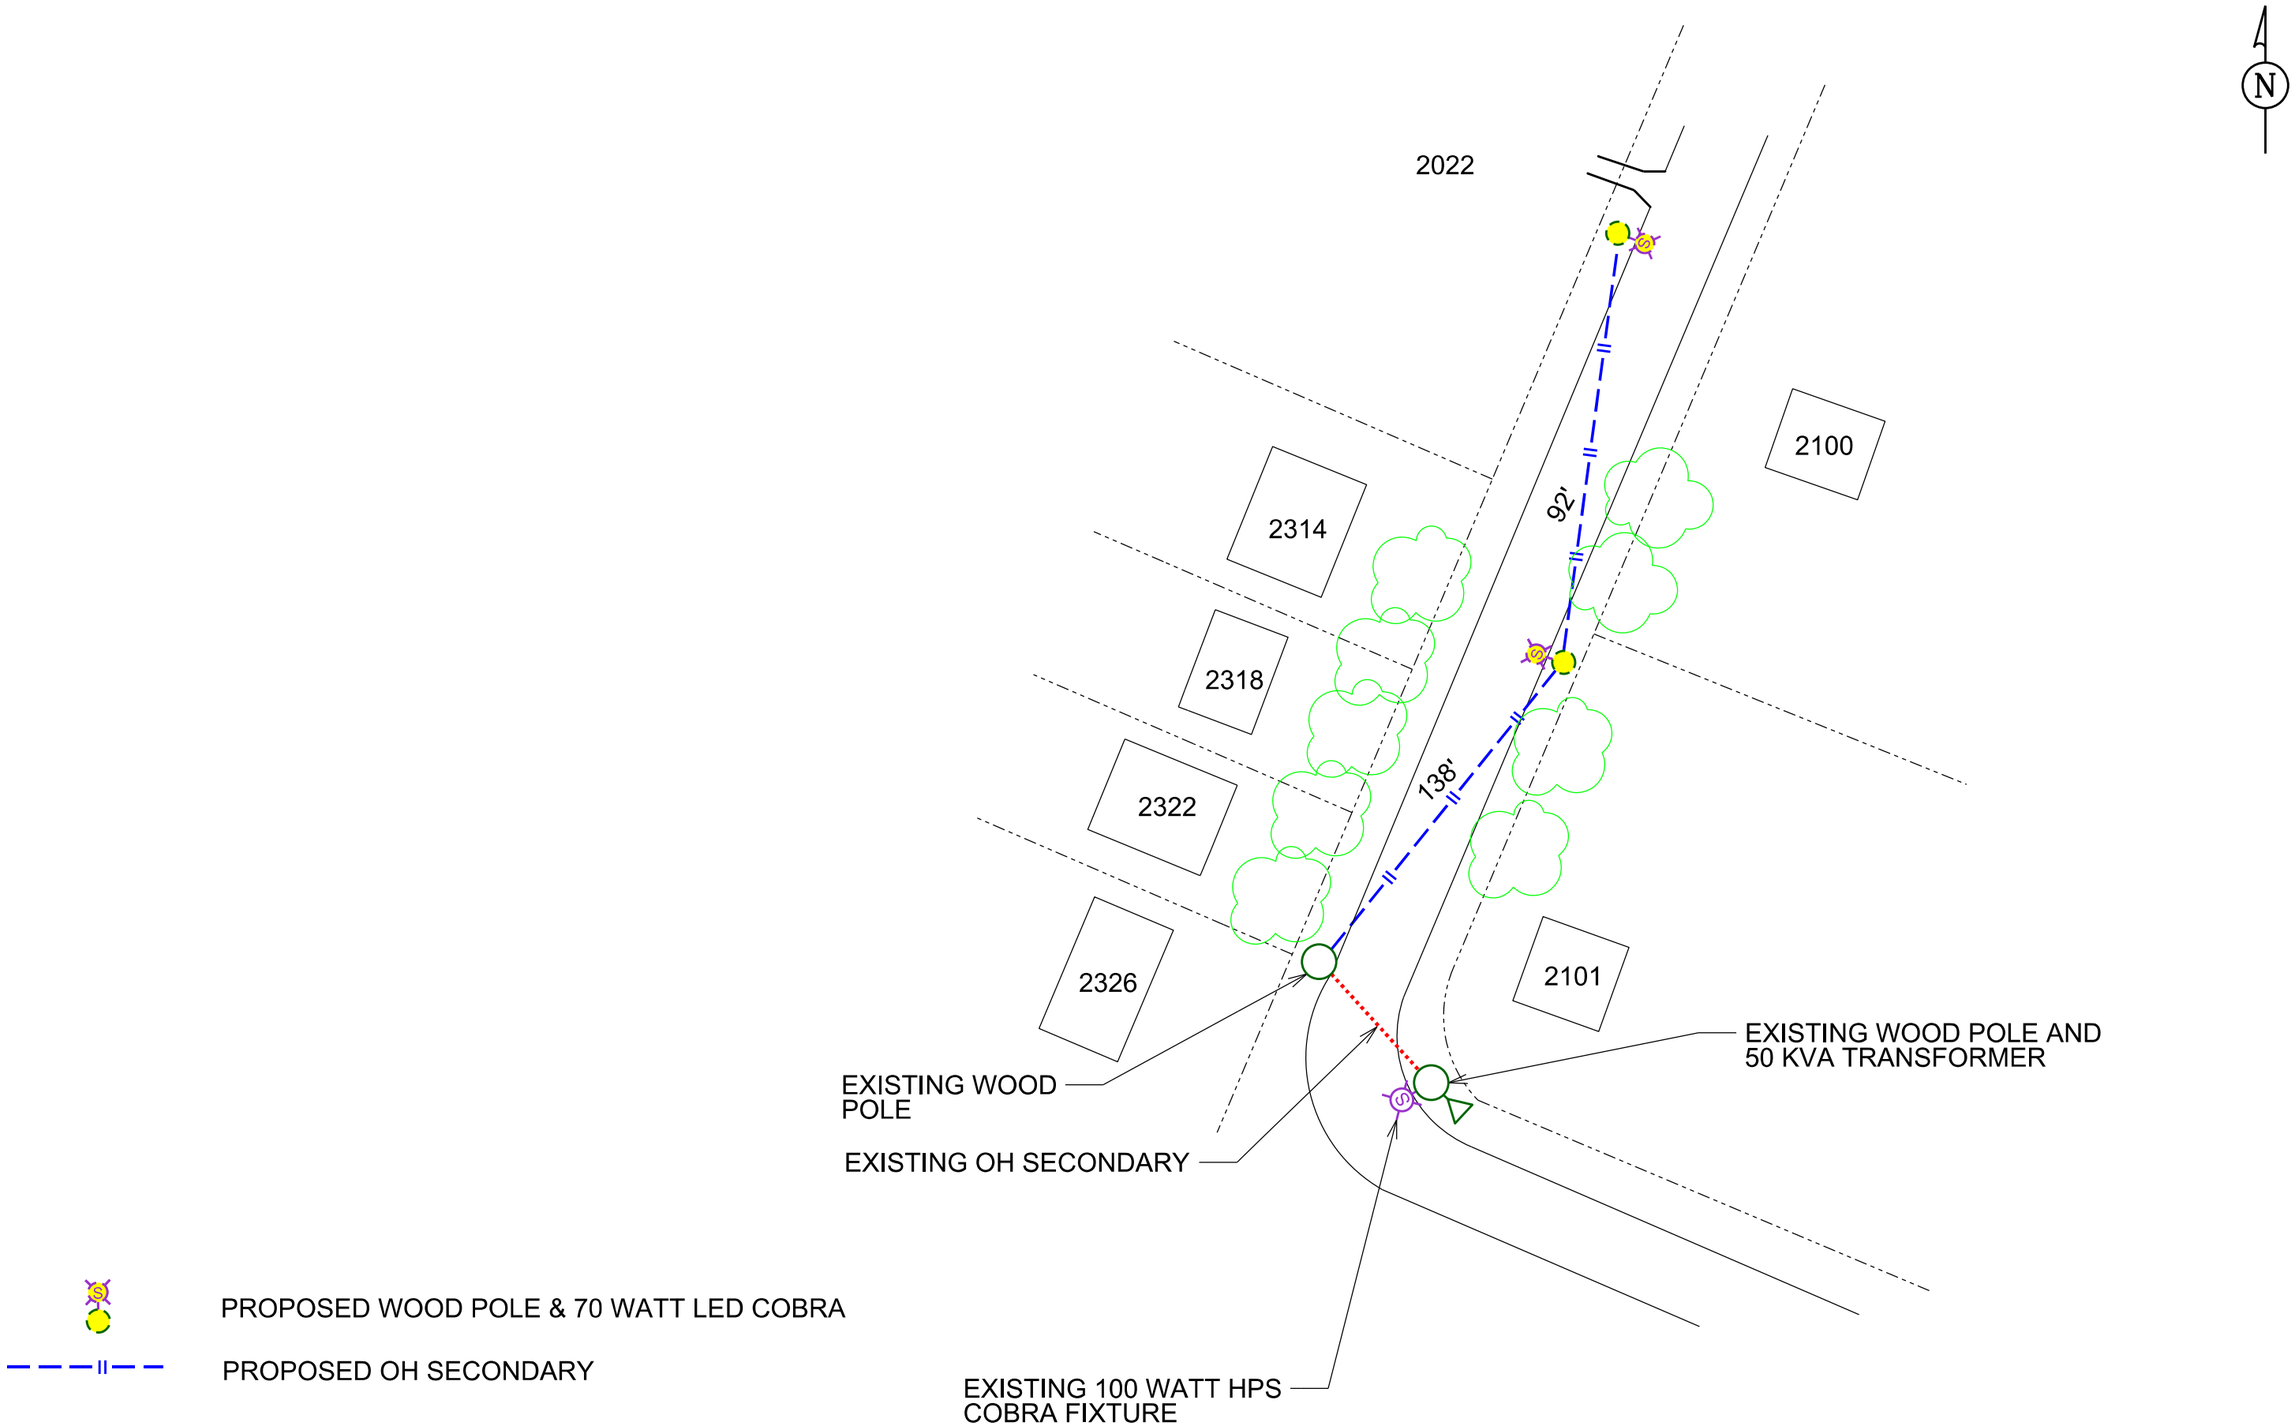
N
2022
2100
2314
2318
2322
2326
2101
92'
138'
EXISTING WOOD POLE
EXISTING OH SECONDARY
EXISTING WOOD POLE AND 50 KVA TRANSFORMER
EXISTING 100 WATT HPS COBRA FIXTURE
PROPOSED WOOD POLE & 70 WATT LED COBRA
PROPOSED OH SECONDARY