



# Install 3 100W HPS Traditional fixtures on style A FB poles

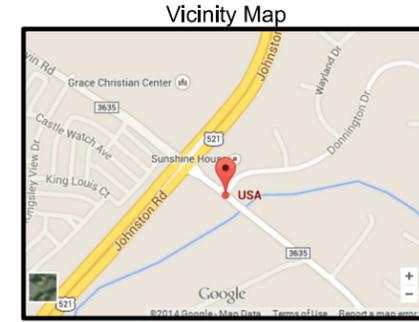

**Legend**

-  Proposed Traditional 100W HPS Traditional fixtures on Style A FB poles
-  Proposed 1 Phase UG Secondary
-  Driveway Punch

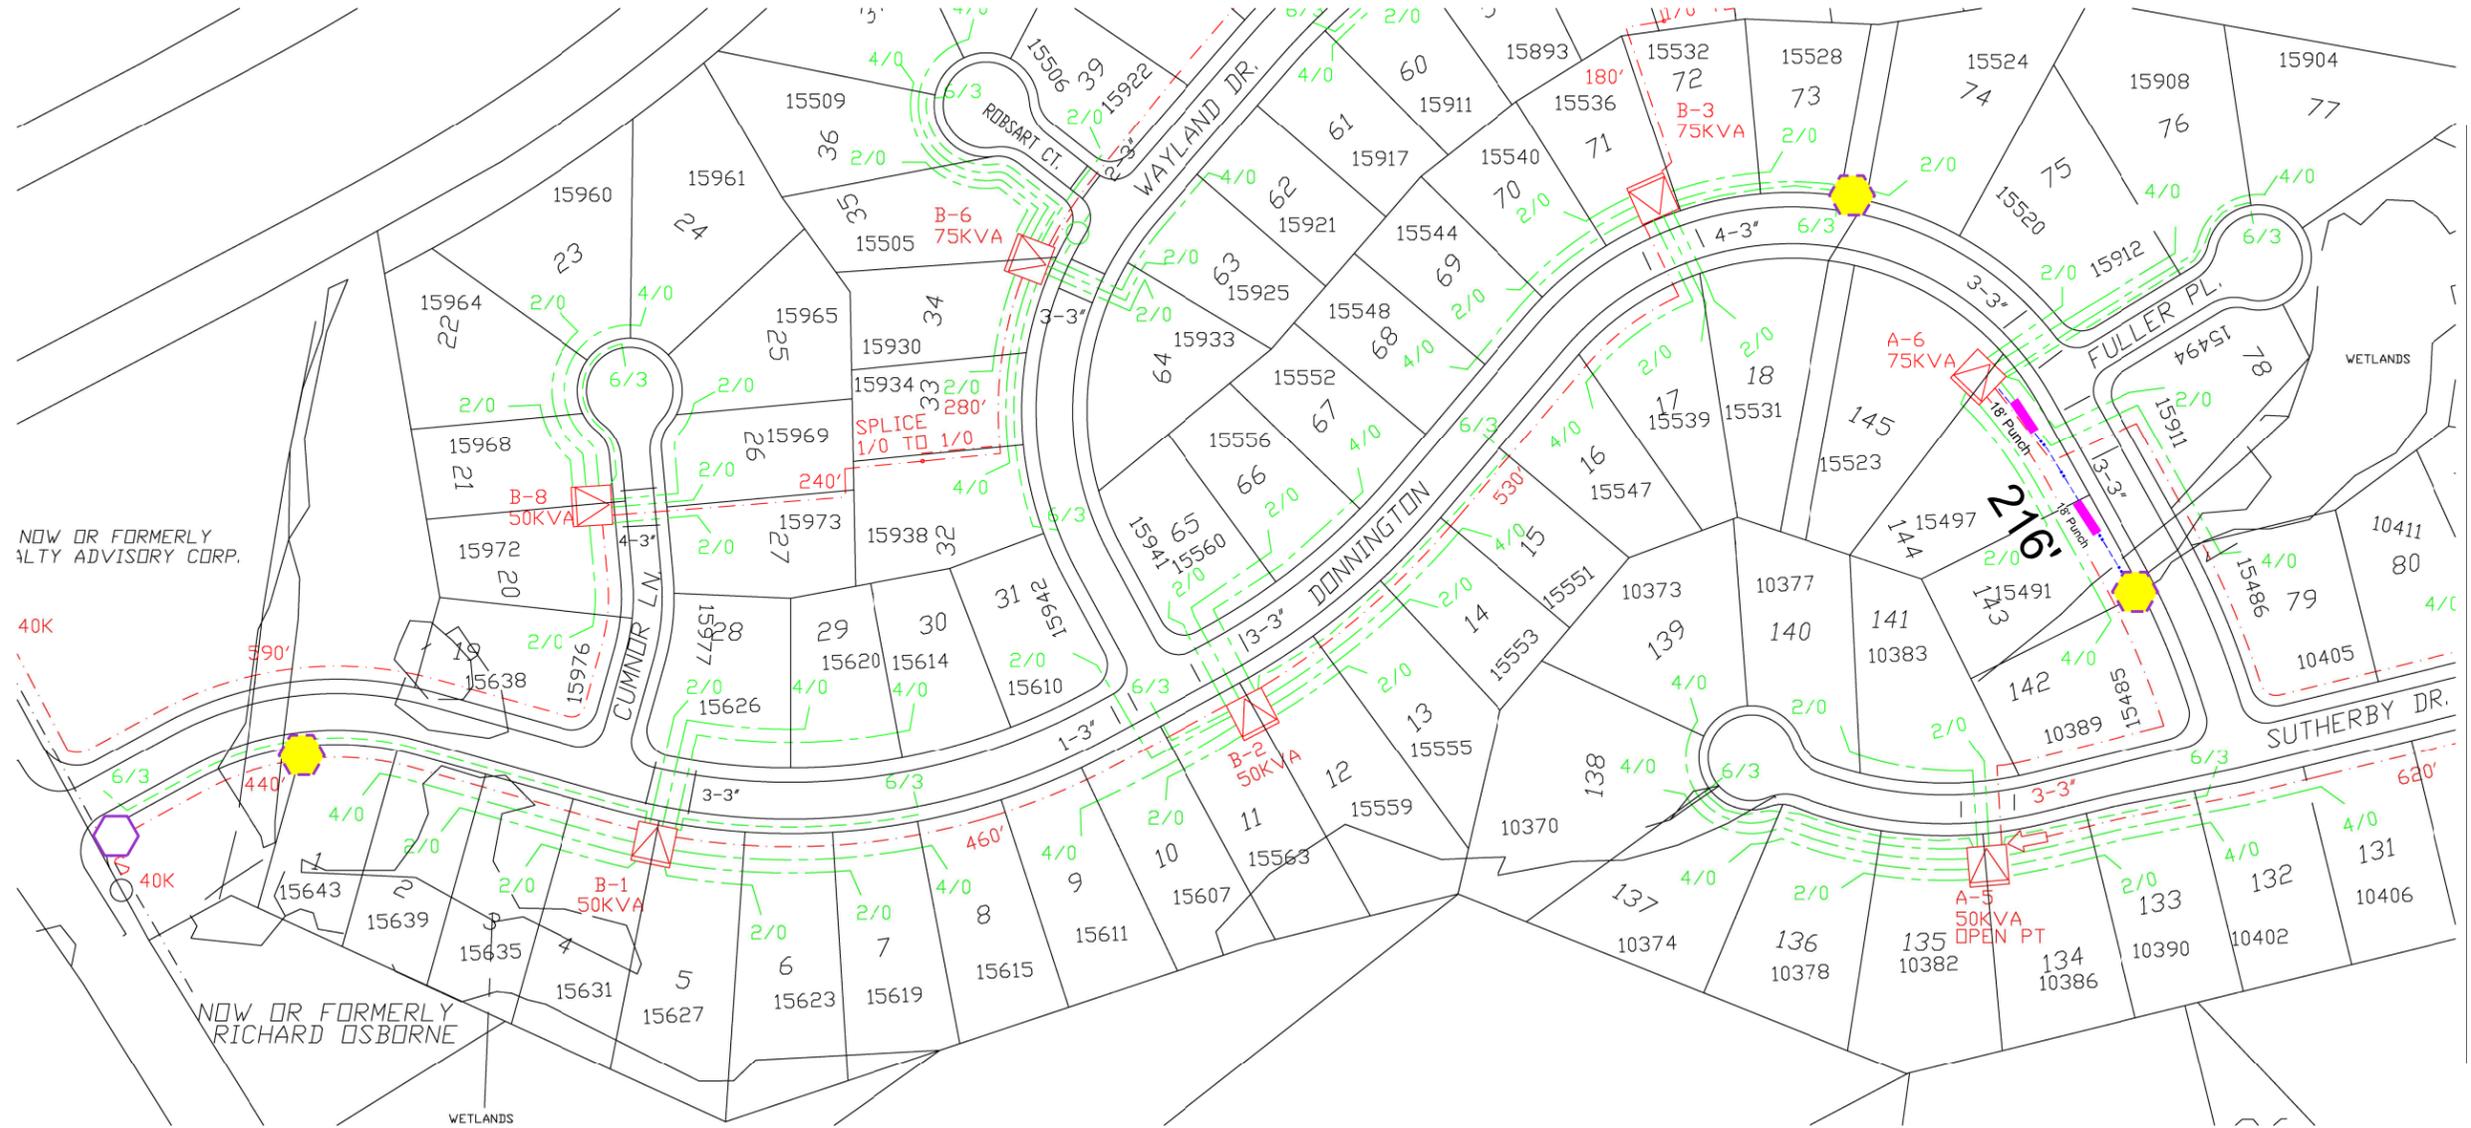

NOW OR FORMERLY  
ALTY ADVISORY CORP.

NOW OR FORMERLY  
RICHARD OSBORNE

Substation Name(s) \_\_\_\_\_  
 Circuit ID(s) \_\_\_\_\_  
 Facility ID(s) \_\_\_\_\_  
 Work Order Number \_\_\_\_\_  
 Customer/Contact \_\_\_\_\_  
 Contact Phone \_\_\_\_\_  
 Job Site Address \_\_\_\_\_  
 City \_\_\_\_\_  
 County \_\_\_\_\_  
 State, Zip \_\_\_\_\_  
 Designer \_\_\_\_\_  
 Designer Phone \_\_\_\_\_  
 Double click to add additional notes and details to drawing.