




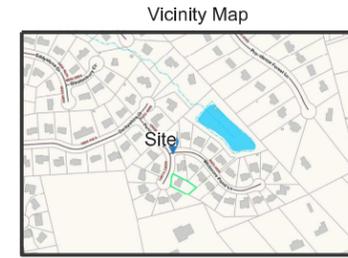

?:  
 ??:  
 ??:  
 ??:  
 ??:



**REMEMBER: Work zone area conditions may have changed for this job! Everyone is responsible for verifying the above safety information is correct prior to any work being performed each day.**

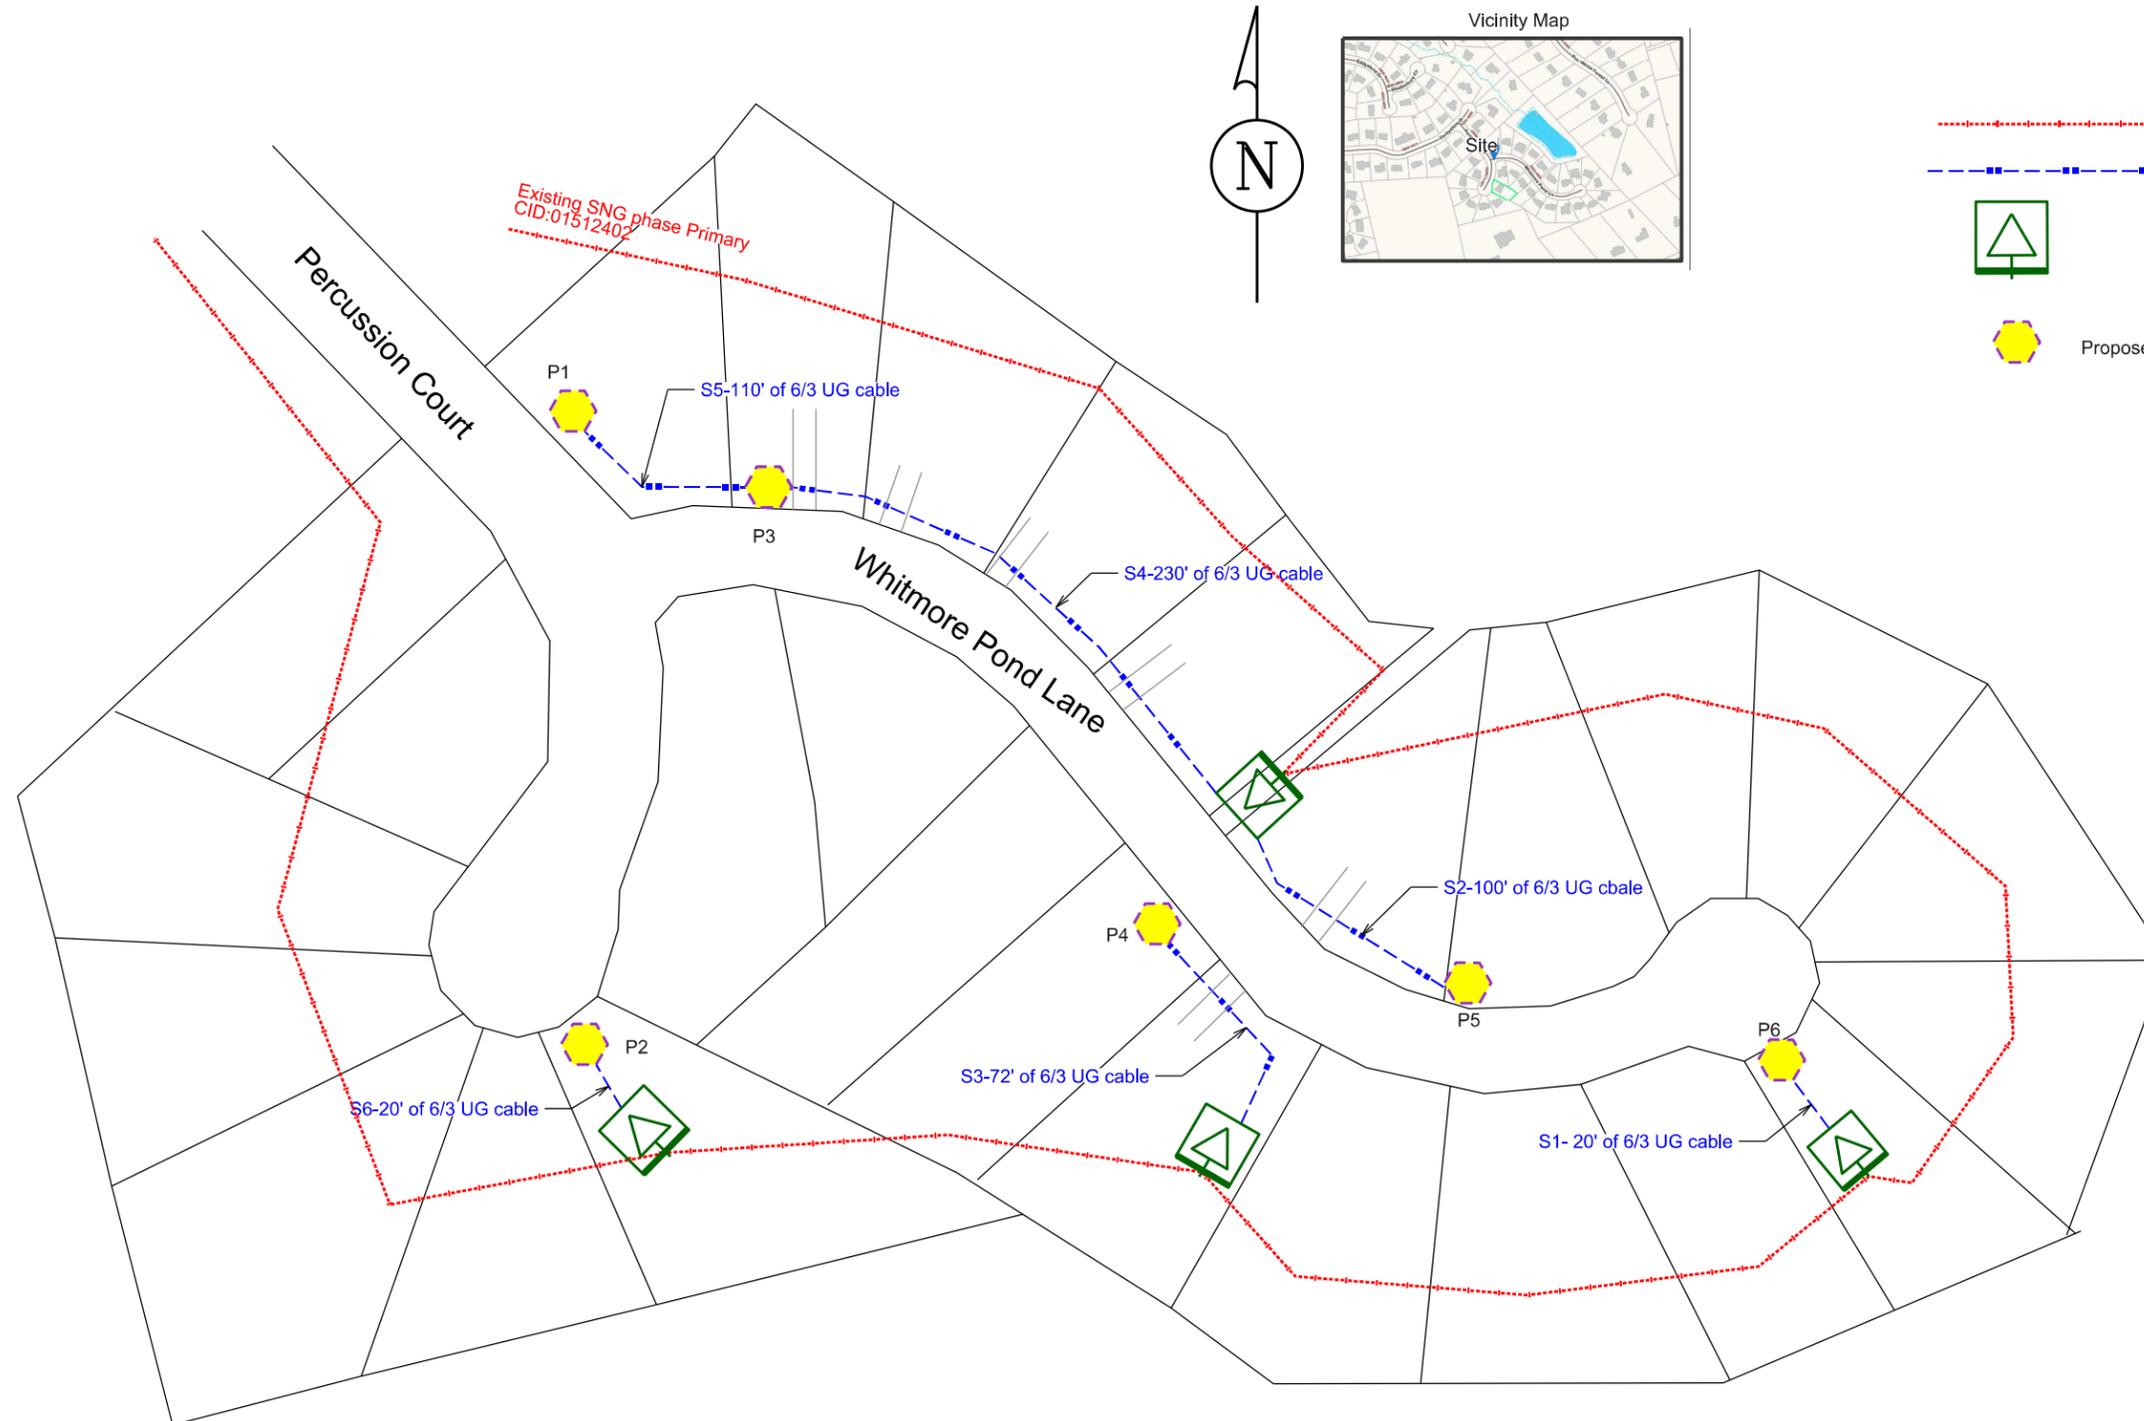

- Existing SNG phase Primary
- Proposed 6/3 UG cable
- Existing Transformer
- Proposed Street light 50W LED Acorn on direct bury Style A-AL pole

Substation Name(s)	_____
Circuit ID(s)	_____
Facility ID(s)	_____
Work Order Number	10798884
Customer/Contact	WHITMORE HOA
Contact Phone	704-382-8021
Job Site Address	PERCUSSION CT
City	CHARLOTTE
County	MECKLENBURG
State, Zip	NC, 28270
Designer	Todd Chapman
Designer Phone	704-577-9573
Double click to add additional notes and details to drawing.	