



TYPICAL PLAN

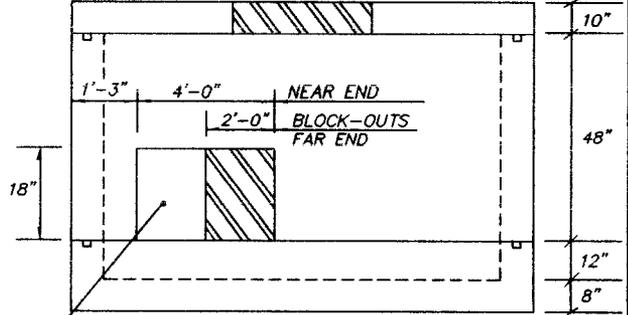

END VIEW "A-A"

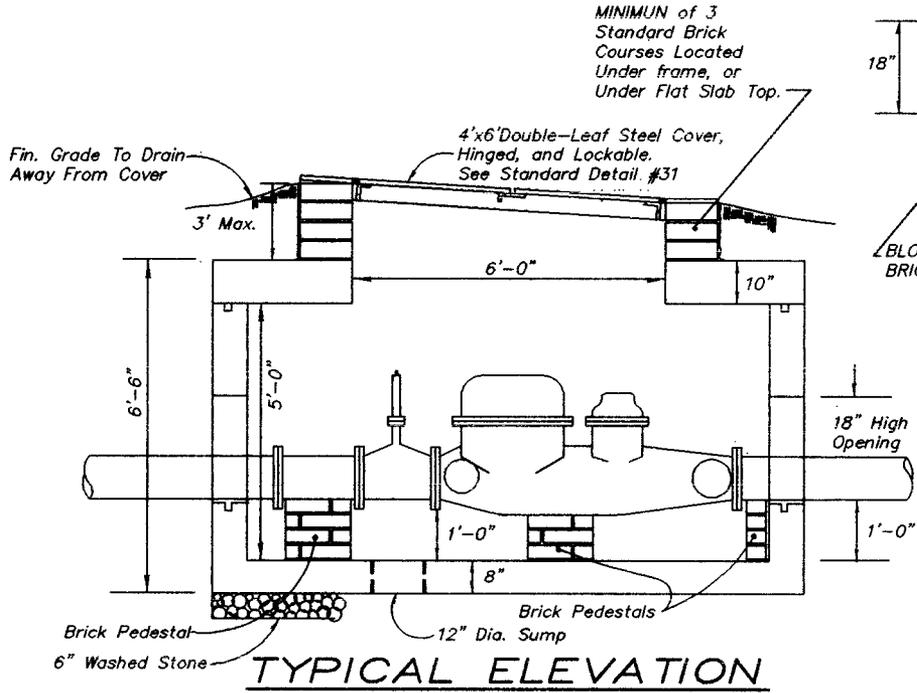

TYPICAL ELEVATION

METER SIZE	10"x6"	10"x12"x6"
A	8½"	7"
B	8½"	7"
C	19"	17"
D	41"	43"
E	34"	34"
F	30"	30"
G	27"	27"
H	49"	51"

NOTES:
 ALL PIPE FOR 10"x 6" METER SHALL BE 10" D.I.P. ONLY
 ALL PIPE FOR 10"x 12"x 6" METER SHALL BE 12" D.I.P. ONLY
 METER CONFIGURATION MAY VARY DUE TO BRAND SUPPLIED.
 INSTALL OPEN RIGHT GATE VALVES INSIDE METER VAULT, EXCEPT HAND WHEEL VALVE WHICH IS OPEN LEFT.
 ALL PIPE SHALL BE RESTRAINED JOINT FROM THE TAP TO THE PROPERTY LINE VALVE.

**CHARLOTTE—MECKLENBURG
 UTILITY DEPARTMENT
 ENGINEERING DIVISION
 CHARLOTTE, NORTH CAROLINA**

**STANDARD DETAIL
 WATER**

**10"x6" & 10"x12"x6"
 METER & 8'x10' VAULT**

Job No. _____	File No. _____
PLAN _____	Scale NO SCALE
PROFILE _____	Hor. _____
	Vert. _____
As Built _____	Date _____
Surveyed By _____	Designed By _____
Drawn By JRM	Project-Engr _____
Approved By RJD	Date 2/01
Sheet 26	Of _____

No.	Date	By	Revision

SDW25.DWG
11/29/99