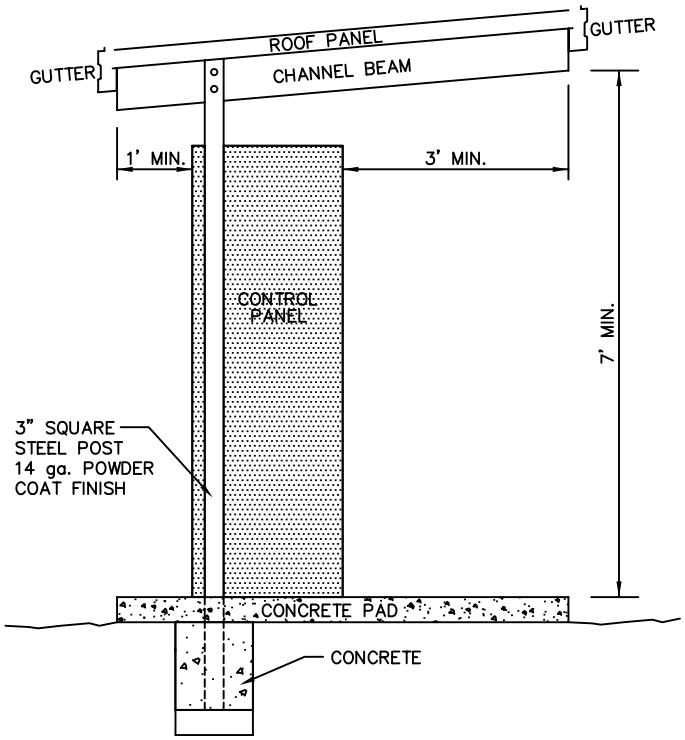

SIDE VIEW

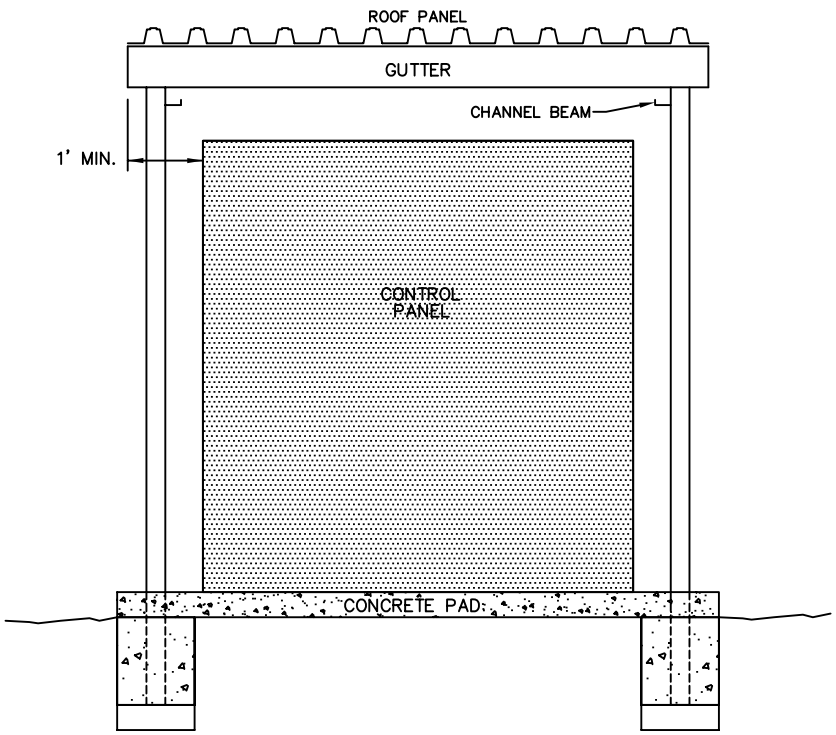

FRONT VIEW

NOTES:

1. STRUCTURE AND FOOTING SHALL BE DESIGNED TO WITHSTAND 100 MPH WIND LOAD.
2. ROOF PANEL, CHANNEL BEAM AND GUTTERS SHALL BE OF ALUMINIUM.

CHARLOTTE–MECKLENBURG UTILITIES
SYSTEM PROTECTION DIVISION
CHARLOTTE, NORTH CAROLINA

Job No. / File No.	STANDARD DETAIL SEWER PUMP STATION
Scales: PLAN N.T.S. / PROFILE Hor. / Vert.	CONTROL PANEL SHELTER
As Built / Date	

No.	Date	By	Revision

Surveyed By	Designed By	Drawn By	Project–Engr	Approved By	Date	Sheet
		BJW	EAB		2/2004	6