


PLAN - SUPPORT BRACKET

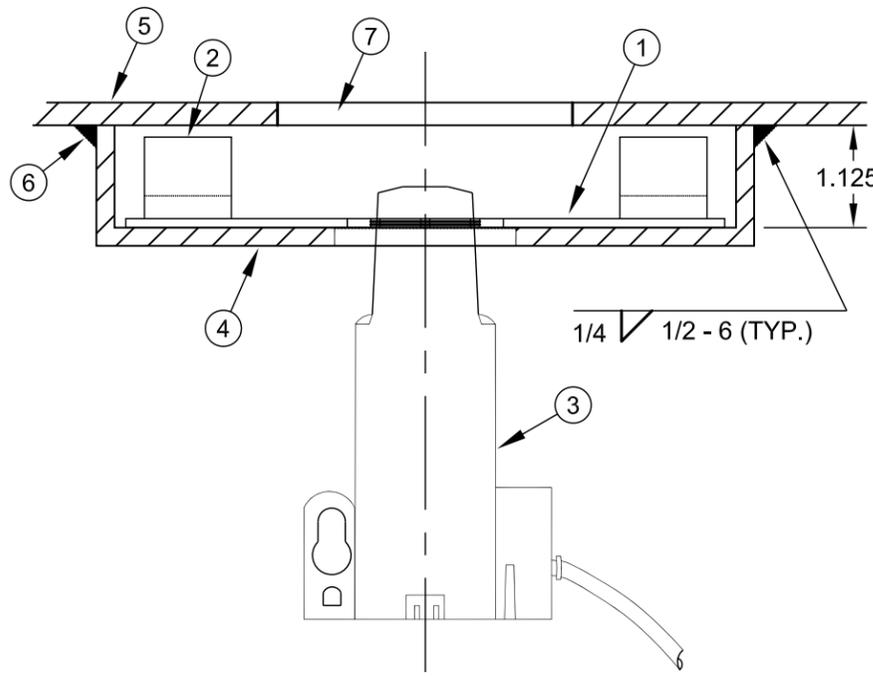


SECTION "A-A" - SUPPORT BRACKET

**NO. DESCRIPTION**


1. ITRON 6.7" DIA. SHELF MOUNT ADAPTOR W/FOAM SPACERS
2. FOAM SPACERS 2 EA. (TYPICAL)
3. ITRON ERT TRANSMITTER
4. SUPPORT BRACKET (1/4" STEEL OR ALUMINUM PLATE)
5. DIAMOND PLATE DOOR LEAF
6. FILLET WELD SUPPORT BRACKET AT CORNERS
7. TRANSMITTER SLOTS - 4 EA. AS SHOWN

**NOTES:**


- A. ONE SUPPORT BRACKET REQUIRED FOR EACH METER IN VAULT.
- B. SELF MOUNT ADAPTER SHALL BE SNAPPED ONTO ERT TRANSMITTER.
- C. TRANSMITTER/MOUNT ADAPTER SHALL BE INSERTED INTO SUPPORT BRACKET AS SHOWN.
- D. DOOR LEAF AND SUPPORT BRACKET SHALL BE OF LIKE MATERIALS.
- E. SEE ACCESS DOOR STANDARD DETAILS FOR SUPPORT BRACKET LOCATIONS.

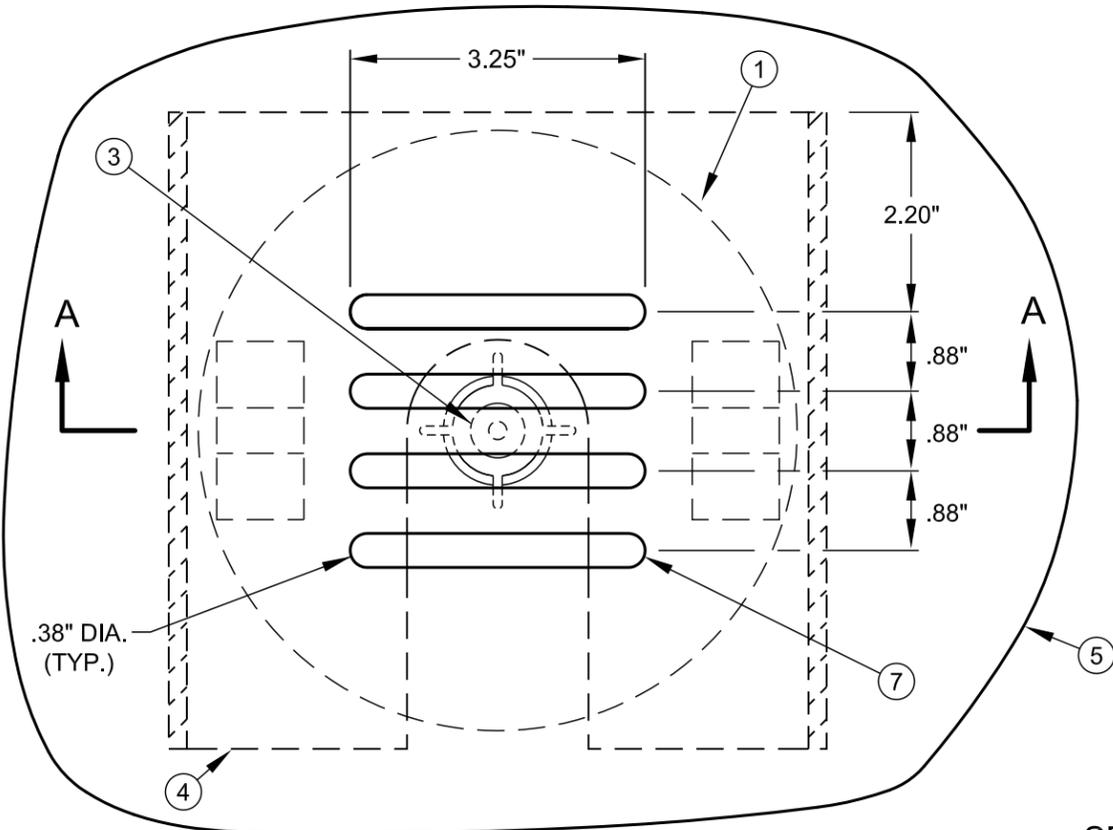

PLAN - TRANSMITTER SLOT DETAIL

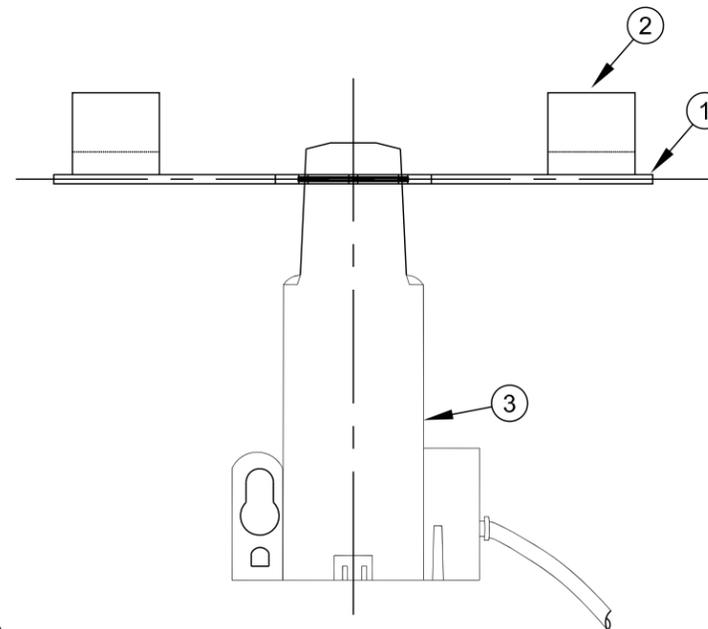

SECTION - TRANSMITTER & SELF MOUNT ADAPTER

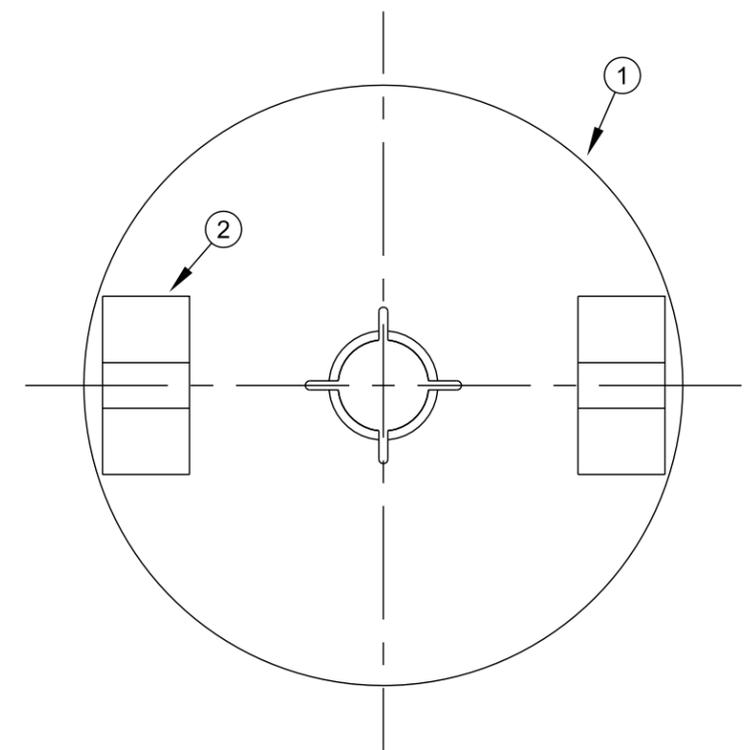

PLAN - SELF MOUNT ADAPTER

NO SCALE

STANDARD NO.	X
VERSION NO.	V1.0
VERSION DATE	8.27.2010

ERT TRANSMITTER SUPPORT BRACKET  
& ERT SELF-MOUNT ADAPTER

CHARLOTTE-MECKLENBURG  
UTILITIES  
STANDARD DETAILS  
WATER

