

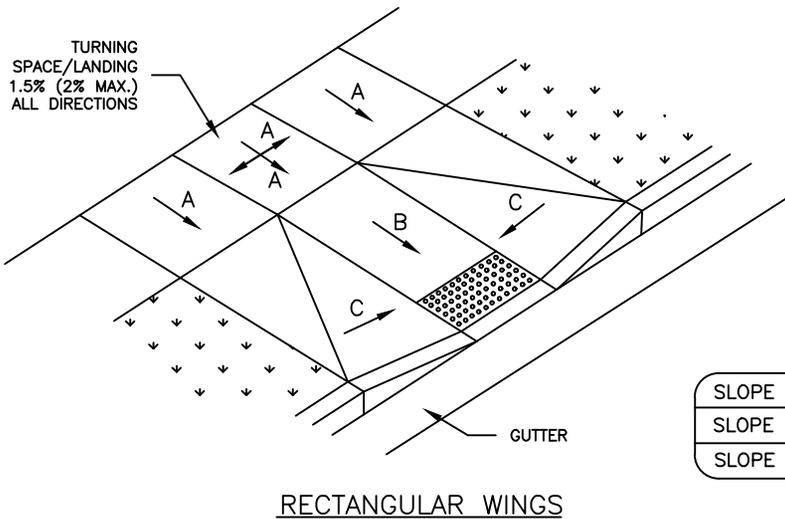


NOTES:

1. THIS DETAIL PRESENTS ALTERNATIVE TREATMENTS FOR THE SIDES OF THE RAMP – RETURNED CURBS, RECTANGULAR WINGS, AND ANGLED WINGS.
2. ENSURE FLUSH CONDITIONS AT CURB RAMP TO GUTTER TRANSITION.
3. TYPICALLY, THE SIDEWALK RUNNING SLOPE SHALL NOT EXCEED THE GENERAL GRADE ESTABLISHED FOR THE ADJACENT STREET.
4. CURB RAMPS WITH RETURNED CURBS MAY BE USED ONLY WHERE PEDESTRIANS WOULD NOT TYPICALLY WALK ACROSS THE RAMP, THE ADJACENT SURFACE IS PLANTING OR OTHER NON-WALKING SURFACE, OR THE SIDE APPROACH IS SUBSTANTIALLY OBSTRUCTED.

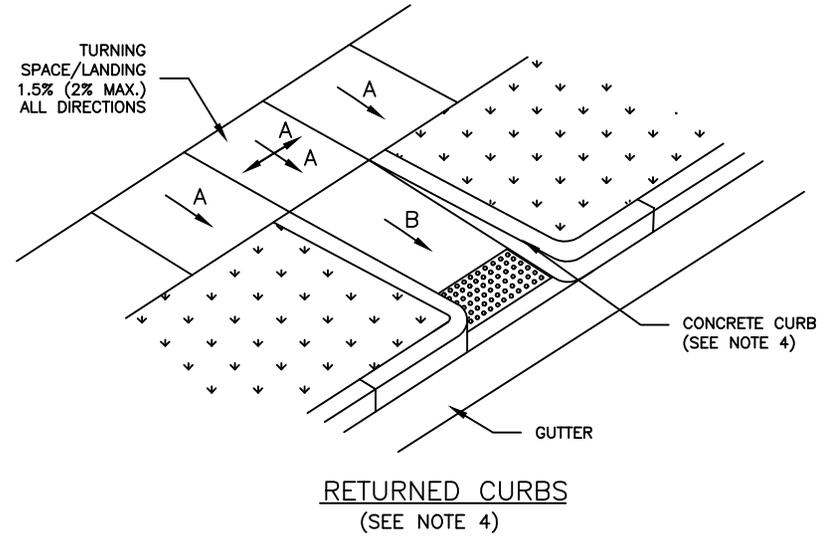

SLOPE "A"	1.5% (2.00% MAX)
SLOPE "B"	7.5% (8.33% MAX)
SLOPE "C"	10% MAX

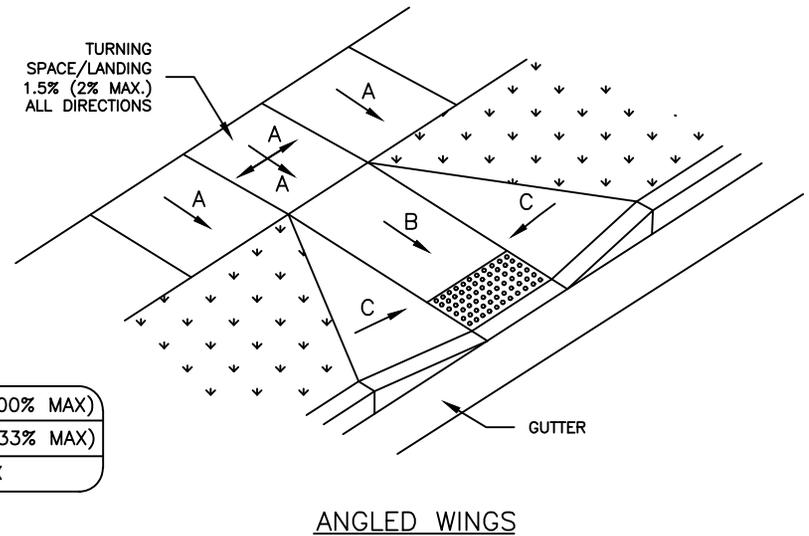

NOT TO SCALE



**CITY OF CHARLOTTE**  
**LAND DEVELOPMENT STANDARDS**  
INCLUDES CHARLOTTE ETJ

PERPENDICULAR CURB RAMP WITH  
2'-6" CURB AND GUTTER

STD. NO.	REV.
10.31B	14