



SLOPE DRAIN, BASE DITCH OR BERM DRAINAGE
OUTLET DITCH

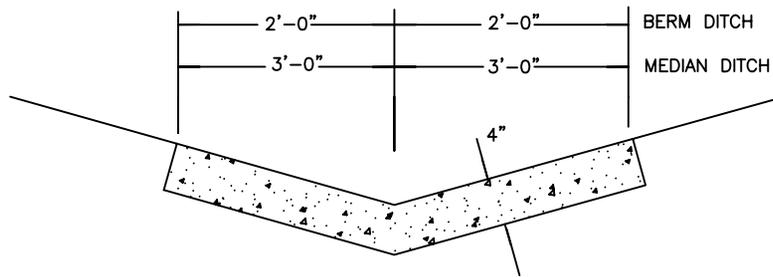

MEDIAN OR BERM DITCH

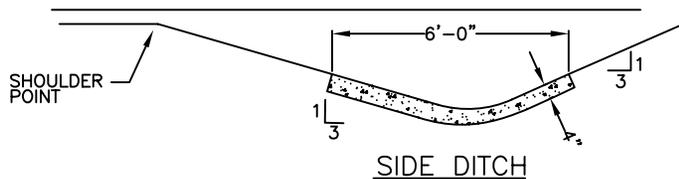


SIDE DITCH

GENERAL NOTES:

IN THE 4" CONCRETE PAVED DITCHES PLACE 1/2" EXPANSION JOINT AT 30 FT INTERVALS AND AT ALL OTHER POINTS WHERE PROPOSED DITCHES ABUT RIGID OBJECTS. PLACE GROOVED JOINTS 1" DEEP AT 10' INTERVALS BETWEEN EXPANSION JOINTS.


WIDTH AND SHAPE OF PROPOSED 4" CONCRETE PAVED DITCHES SHALL BE AS SHOWN OR AS DIRECTED BY THE ENGINEER.

ALL CONCRETE TO BE 3600 P.S.I. COMPRESSIVE STRENGTH.

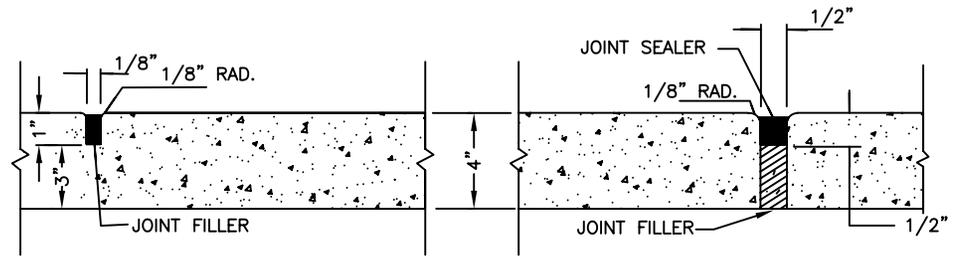

SHOWING GROOVED JOINT

SHOWING EXPANSION JOINT

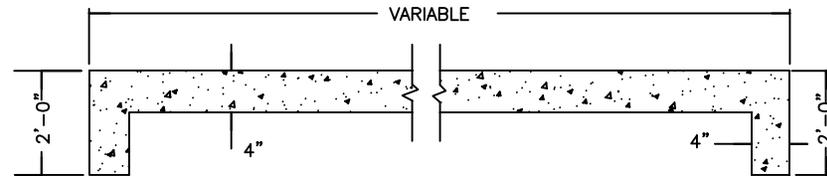

LONGITUDINAL SECTION OF PAVED DITCH

SHOWING 2'-0" CURTAIN WALL REQUIRED AT EACH END

NOT TO SCALE



**CITY OF CHARLOTTE
LAND DEVELOPMENT STANDARDS
INCLUDES CHARLOTTE ETJ**

CONCRETE PAVED DITCHES

STD. NO.	REV.
20.26	