



WATER MAIN CONNECTIONS

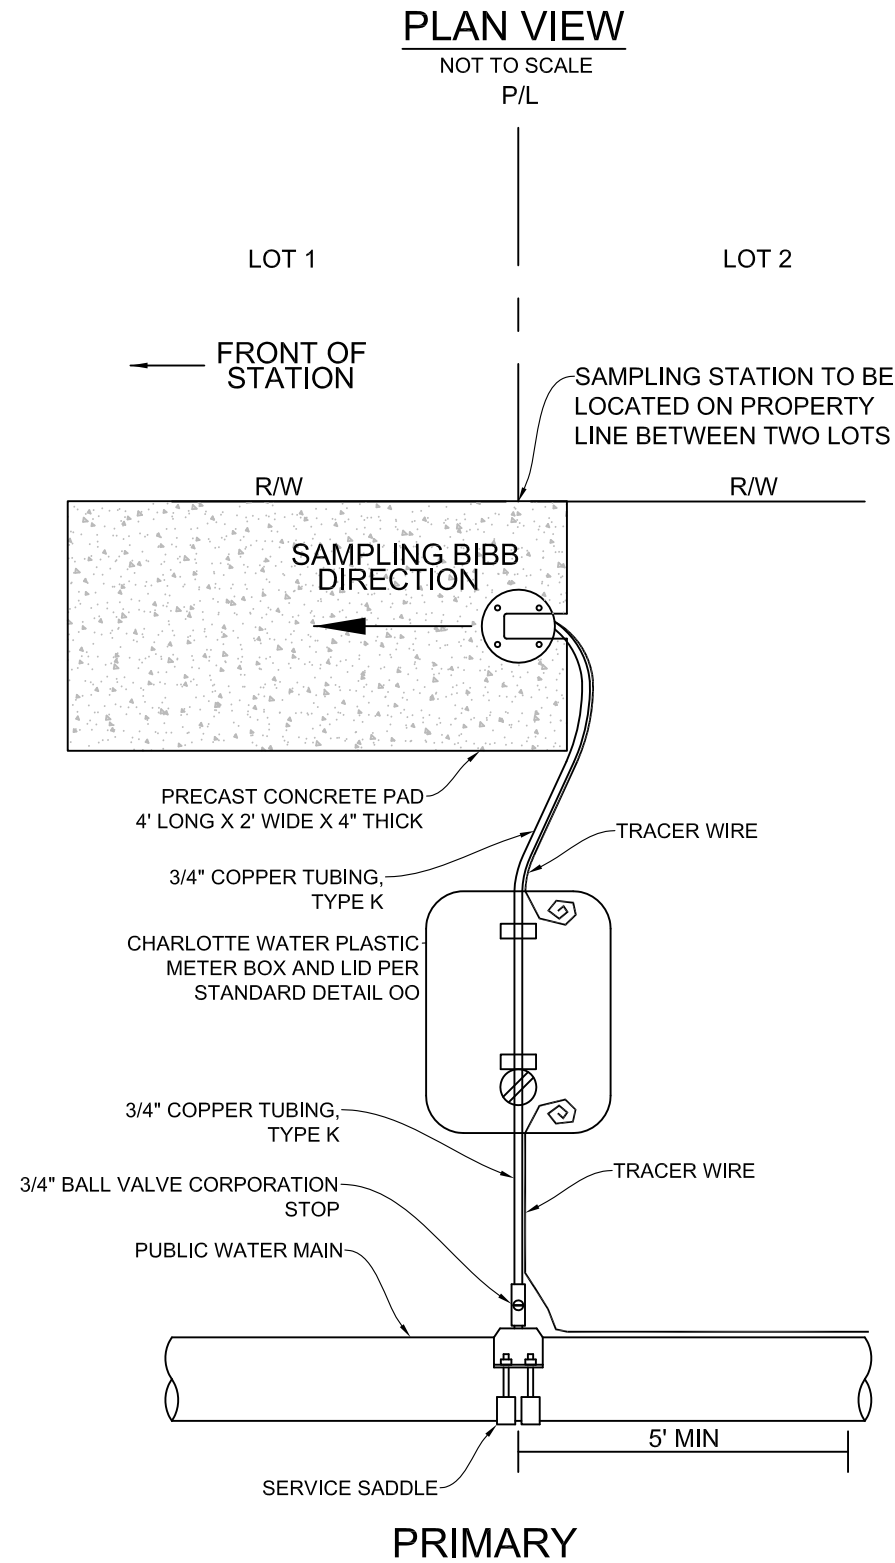

*TAP SHALL ONLY BE CONNECTED DIRECTLY TO A CHARLOTTE WATER PUBLIC MAIN AND MAY NOT BE CONNECTED TO WATER SERVICE PIPING, FIRE HYDRANT FEEDER LEG, AIR RELEASE OR BLOW-OFF PIPING.


SAMPLING STATION PLUMBING

NOT TO SCALE

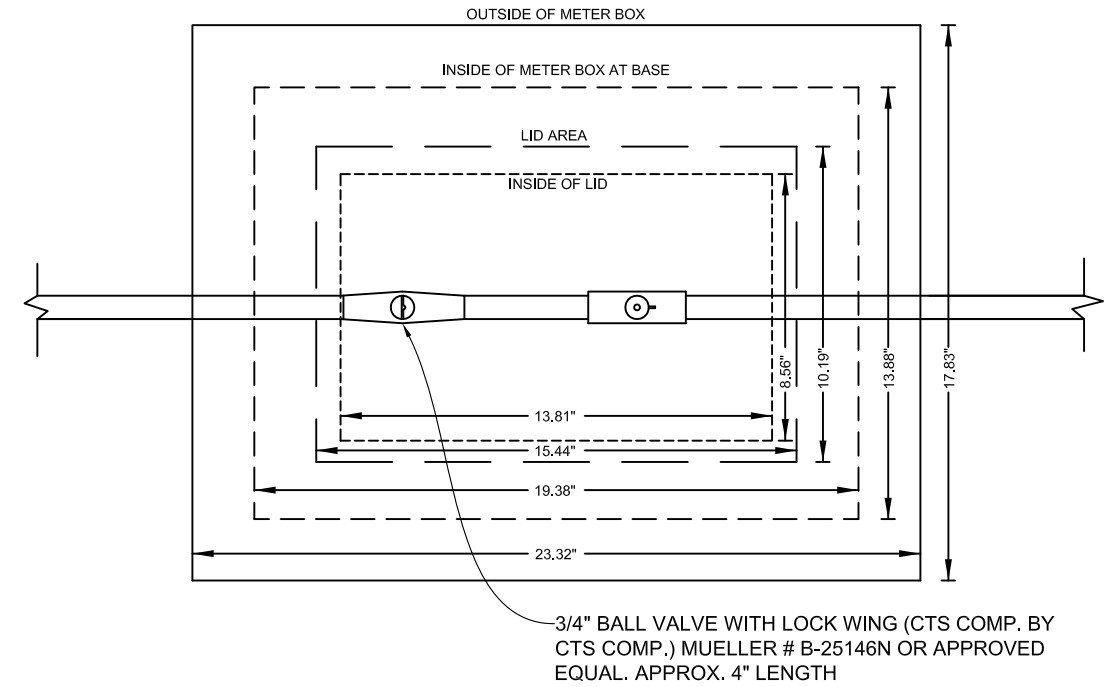

PLAN VIEW

NOT TO SCALE

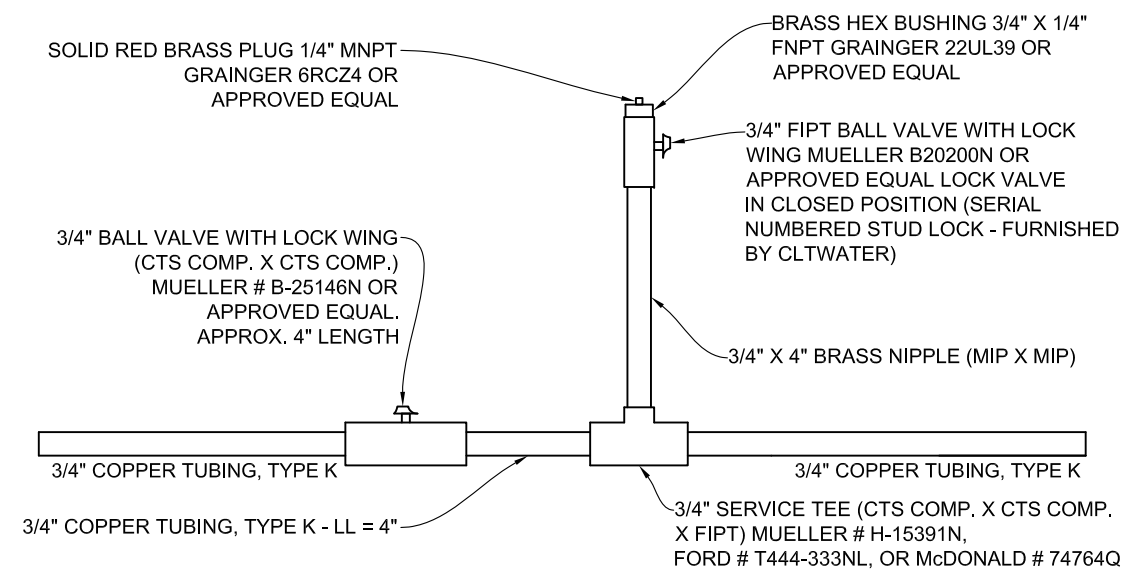

ELEVATION VIEW

NOT TO SCALE

STANDARD NO.

XX

VERSION NO.

1.1

VERSION DATE

8.21.2015

WATER QUALITY SAMPLING STATION (2 OF 2)

CHARLOTTE-MECKLENBURG UTILITIES

STANDARD DETAILS

WATER

