

FIRE HYDRANT IN NCDOT R/W

NO SCALE VERSION

A MINIMUM OF 1' INSIDE ROAD R/W.

IN DITCHLINE.

MAINLINE VALVES, GUARD VALVE, AND


FIRE HYDRANT SHALL NOT BE PLACED

HYDRANT SHALL BE UNOBSTRUCTED.

1.0 DATE

04/2024

DETAIL 10.3.6

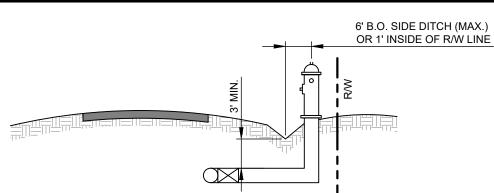

ROAD IN FILL SECTION


1' IN FRONT OF EDGE OF SLOPE

OR 1' INSIDE OF R/W LINE

30' MAX. OR 1' INSIDE OF R/W LINE

ROAD WITH NO SIDE DITCH

ROAD WITH SIDE DITCH

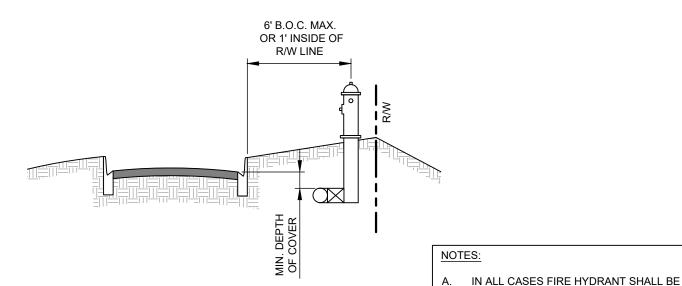

ROAD WITH CURB AND GUTTER