SEWER SERVICES


NO SCALE VERSION

1.0 DATE 04/2024

DETAIL 11.1.9

## **REQUIREMENT 2**


MINIMUM SPACING BETWEEN SEWER SERVICES AND PARALLEL STORM PIPES/CATCH BASINS: 5'



**REQUIREMENT 3** 

MINIMUM SPACING BETWEEN SEWER SERVICES

AND WATER SERVICES: 5'

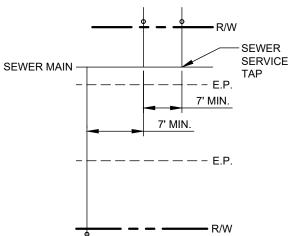


**REQUIREMENT 1** 

MINIMUM SPACING BETWEEN

SEWER TAPS: 7'

**PLAN VIEW** (HORIZONTAL SEPARATION)




**PLAN VIEW** (HORIZONTAL SEPARATION)

# **PLAN VIEW** (HORIZONTAL SEPARATION)

### **REQUIREMENT 4**


SEWER SERVICES PROHIBITED INSIDE CURB RADIUS POINT OF PUBLIC AND PRIVATE ROAD INTERSECTIONS



**PLAN VIEW** 

# **REQUIREMENT 5**

MINIMUM CLEARANCE BETWEEN PROPERTY LINE AND SEWER SERVICE: 3'

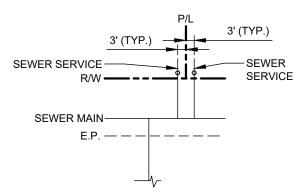

**PLAN VIEW** (HORIZONTAL SEPARATION)