



**REQUIREMENT 1**  
MINIMUM SPACING BETWEEN WATER TAPS: 3 FT

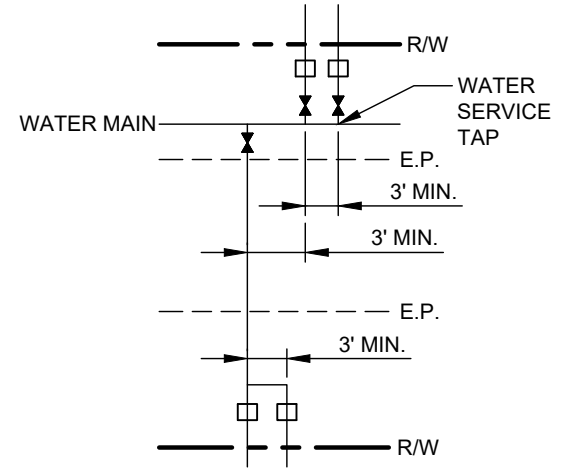


PLAN VIEW  
(HORIZONTAL SEPARATION)

**REQUIREMENT 2**  
MINIMUM CLEARANCE OF WATER TAP TO PIPE JOINTS OR FITTINGS: 3 FT

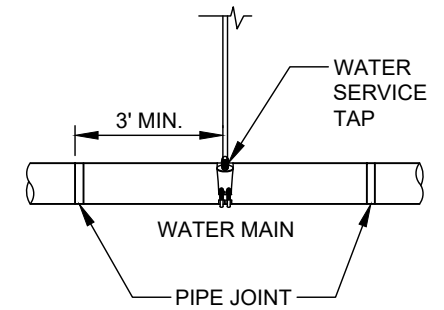


PLAN VIEW  
(HORIZONTAL SEPARATION)

**REQUIREMENT 3**  
MINIMUM SPACING BETWEEN WATER SERVICES AND PARALLEL STORM PIPES/CATCH BASINS: 5 FT

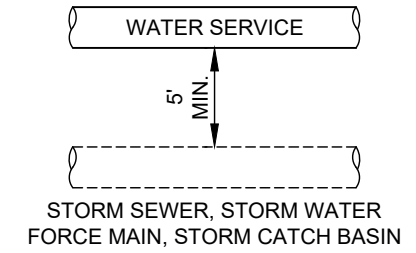


PLAN VIEW  
(HORIZONTAL SEPARATION)

**REQUIREMENT 4**  
MINIMUM SPACING BETWEEN WATER SERVICES AND SEWER SERVICES: 5 FT

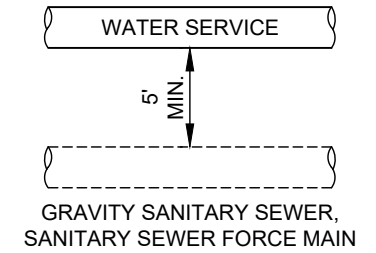


PLAN VIEW  
(HORIZONTAL SEPARATION)

**REQUIREMENT 5**  
WATER SERVICES PROHIBITED INSIDE CURB RADIUS POINT OF PUBLIC AND PRIVATE ROAD INTERSECTIONS

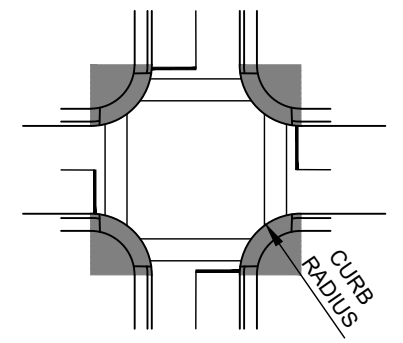


PLAN VIEW

**REQUIREMENT 6**  
WATER SERVICE VAULTS PROHIBITED WITHIN 10 FT OF COMMERCIAL DRIVEWAYS OR WITHIN THE CURB RADIUS POINT, WHICHEVER IS GREATER

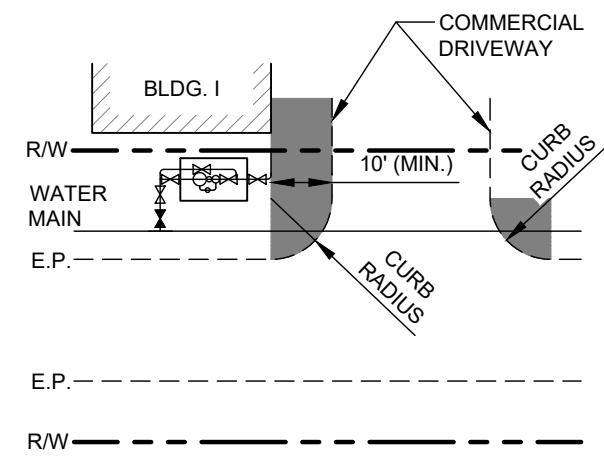


PLAN VIEW  
(HORIZONTAL SEPARATION)

**REQUIREMENT 7**  
WATER SERVICE METER BOXES PROHIBITED WITHIN 3 FT OF RESIDENTIAL DRIVEWAYS

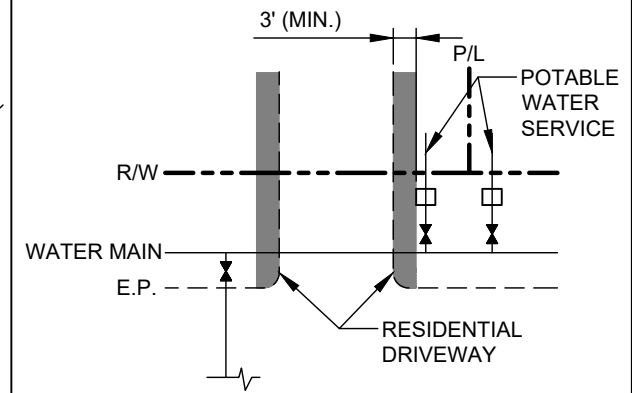

PLAN VIEW  
(HORIZONTAL SEPARATION)

**REQUIREMENT 8**  
MINIMUM CLEARANCE BETWEEN PROPERTY LINE AND WATER SERVICE/VAULT: 3 FT

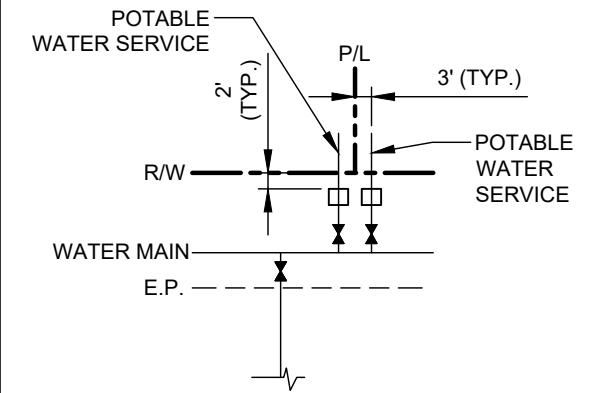

PLAN VIEW  
(HORIZONTAL SEPARATION)