


NOTES:

- A. ALL FLANGE HARDWARE (BOLT/WASHER/NUT) SHALL BE STAINLESS STEEL - TYPE 304 WITH ANTI-SEIZE COMPOUND.
- B. ALL PIPE SHALL BE RESTRAINED JOINT DUCTILE IRON FROM TAP TO PROPERTY LINE VALVE.
- C. METER CONFIGURATION AND LENGTH / WIDTH MAY VARY DUE TO BRAND - VERIFY DIMENSIONS TO DETERMINE MINIMUM VAULT SIZE.
- D. VAULT SHALL BE SIZED AS NEEDED FOR MINIMUM CLEARANCE AS SHOWN AND RATED FOR NCDOT HS-20 LOADING - SUBMIT SHOP DRAWINGS / P.E. SEALED FOR REVIEW.
- E. ALL CONCRETE SHALL BE MINIMUM 4,000 PSI COMPRESSIVE STRENGTH.
- F. DESIGN SHALL CONFORM TO ASTM C858 - SPECIFICATIONS FOR "UNDERGROUND PRECAST CONCRETE UTILITY STRUCTURE".


- G. STEEL REINFORCING DESIGN SHALL CONFORM TO ASTM C857.
- H. REBAR SHALL BE GRADE 60 PER ASTM A615.
- I. WELDED WIRE FABRIC SHALL CONFORM TO ASTM A185.
- J. DIAGONAL REINFORCING SHALL BE ADDED AT ALL OPENINGS.
- K. PIPE PENETRATIONS SHALL BE SEALED WITH FLEXIBLE CONNECTORS (MANHOLE BOOTS) OR WITH 8" OF BRICK & MORTAR (AND 1/2-INCH THICK CONSTRUCTION EXPANSION MATERIAL).
- L. FRAME TO BE FLUSH WITH GROUND OR CONCRETE SIDEWALK, GROUND SHALL SLOPE AWAY FROM VAULT.
- M. ALL JOINTS SHALL BE MADE WATERTIGHT USING 2 RINGS OF BUTYL RUBBER JOINT MASTIC.
- N. ALL VALVES SHALL BE OPEN RIGHT - CLOCKWISE, EXCEPT NO. 16.
- O. PRECAST VAULT COMPONENTS SHALL HAVE MARKINGS PER ASTM C478 REQUIREMENTS.

NO. DESCRIPTION:

1. 10" OUTLET TAPPING SLEEVE AND 10" FL X MJ TAPPING VALVE ON EXISTING MAIN. 10" MJ OUTLET TEE, 10" FOSTER ADAPTOR AND 10" MJ GATE VALVE ON NEW MAIN.
2. STANDARD VALVE BOX ASSEMBLY (TYPICAL) - ALL VALVES.
3. 10" DUCTILE IRON PIPE - RESTRAINED.
4. 10" MJ X FL DUCTILE IRON ADAPTER ON SHORT SIDE SERVICE (NOT SHOWN), 10" MJ X FL GATE VALVE ON LONG SIDE SERVICE (SHOWN).
5. 10" ALL FLANGE DUCTILE IRON TEE.
6. 10" ALL FLANGE GATE VALVE.
7. 10" ALL FLANGE DUCTILE IRON PIPE SPOOL - L = 50" (MIN.) (SPECIAL CLASS 53).
8. 10" FMCT METER ASSEMBLY (FLANGE X FLANGE)
 - 8.1. BERMAID MODEL FP-60F-D FIRE RATED BASKET STRAINER (FL X FL). LL = 22.0"
 - 8.2. 10-INCH MASTER METER OCTAVE OR NEPTUNE MACH10 WITH ITRON W100 TRANSMITTER - LL = 17.75"
 - 8.3. 10" EPOXY COATED/LINED STEEL FL X FL SPOOL WITH 2" FNPT TEST OUTLET - LL = 12" (MARS CO.) AND 2" BALL CORPORATION STOP WITH T-HEAD OPERATING NUT - MNPT X FNPT.
 - 8.4. ROMAC D J400 DISMANTLING JOINT - LL = 9.5" TO 11.5", SET TO 10.5" OR SMITH-BLAIR MODEL 975 DISMANTLING JOINT (RESTRAINED) - LL = 9" TO 11", SET TO 10".
9. 10" DUCTILE IRON 90° BEND FLANGE X FLANGE.
10. 10" DUCTILE IRON PIPE - FLANGE X FLANGE SPOOL - L = 89" (MIN.) (SPECIAL CLASS 53).
11. 10" X 1 1/2" SERVICE SADDLE WITH 1 1/2" BALL CORPORATION STOP WITH T-HEAD OPERATING NUT - CC - TAPER THREAD X FNPT.
12. 10" DUCTILE IRON PIPE - FLANGE X PE - L = 24" (MIN.) (SPECIAL CLASS 53).
13. 10" MECHANICAL JOINT DUCTILE IRON LONG PATTERN SOLID SLEEVE WITH RESTRAINED JOINT.
14. 10" DUCTILE IRON PIPE - FLANGE X PE - L = 12" (MIN.) (SPECIAL CLASS 53).
15. 10" DUCTILE IRON PIPE - FLANGE X PE - L = 30" (MIN.) (SPECIAL CLASS 53).
16. 10" MECHANICAL JOINT (RJ) GATE VALVE - OPEN LEFT AT PROPERTY LINE.
17. 10" MECHANICAL JOINT PLUG WITH 2" TAP (FNPT).
18. 2" TEMPORARY BLOW OFF ASSEMBLY (GALV. STEEL (SCH 80) - END WITH THREADED COUPLING).
19. GALV. STEEL OR S.S. ADJUSTABLE FLANGE PIPE SUPPORTS (NUMBER REQUIRED = 4) (WITH STAINLESS STEEL ADHESIVE ANCHORS).
20. AMR TRANSMITTERS.
21. 5' X 5' ACCESS DOOR - SEE STD. DETAIL.
22. PRECAST REINFORCED CONCRETE VAULT - 10' X 6' X 6.5" (MIN.) (L X W X D). SEE NOTES C AND D.
23. MINIMUM OF THREE STD. SOLID CONCRETE BRICK COURSES (OR PRECAST RISER) UNDER ACCESS DOOR FRAME - MAX. 2". JOINT REQUIRED AT FLAT TOP SECTION.
24. 3/8" DIA. GALV. STEEL EYE BOLT (EPOXY ADHESIVE ANCHOR) - TYPICAL.
25. AWG #12 GAUGE SOLID COPPER TRACER WIRE - WITH BLUE INSULATION (30 MILS HDPE) TERMINATE WITH 24" EXCESS WIRE (COILED) AT EYE BOLT AND VALVE BOX (TYPICAL).
26. CAST IN PLACE CONCRETE SIDEWALK - BRICKWORK SHALL NOT EXTEND TO SURFACE. ACCESS DOOR FRAME SHALL REST ON SIDEWALK.
27. VALVE LOCK (FURNISHED BY CLTW) - LOCK VALVE CLOSED.
28. PLASTIC STEP - 12" O.C. VERTICAL SPACING.
29. ATTACH ENGRAVED LABEL, WITH PREMISE NUMBER, TO UNDERSIDE OF DOOR, NEAR THE LIFTING HANDLE.
30. CONCRETE THRUST BLOCKING - 3,600 PSI.

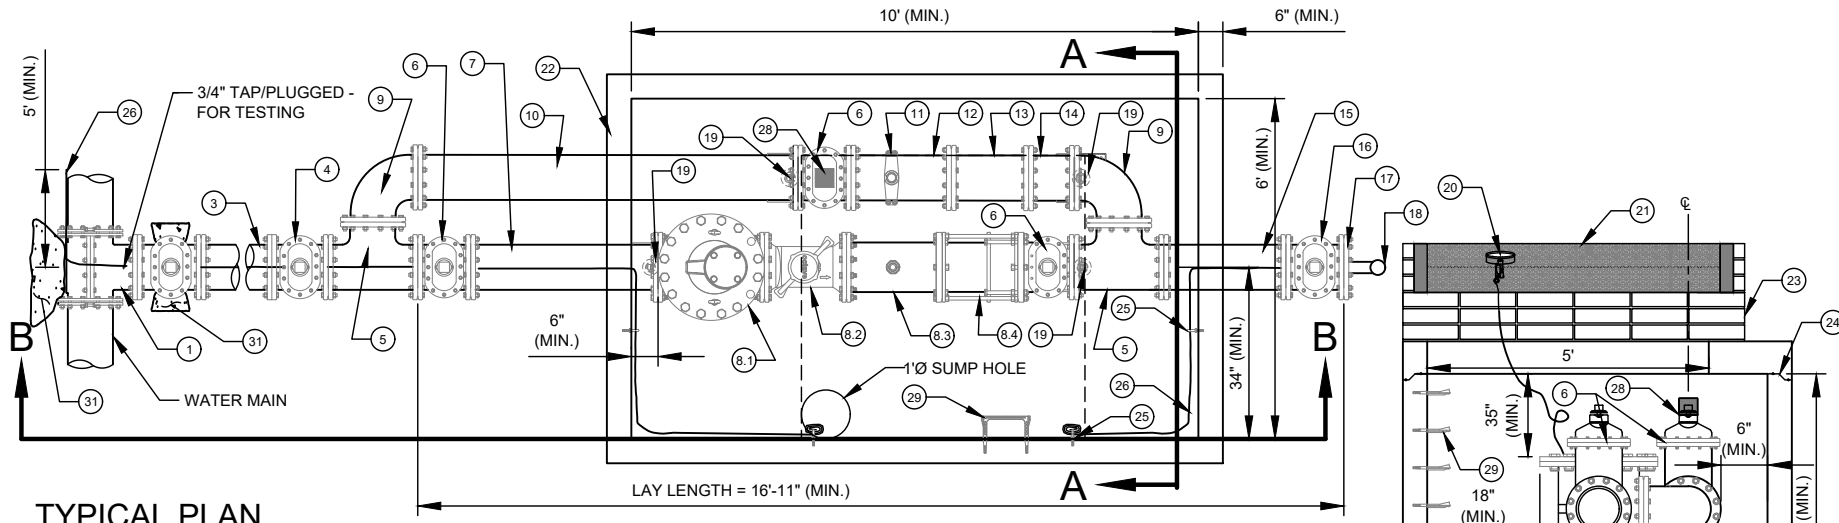

TYPICAL PLAN

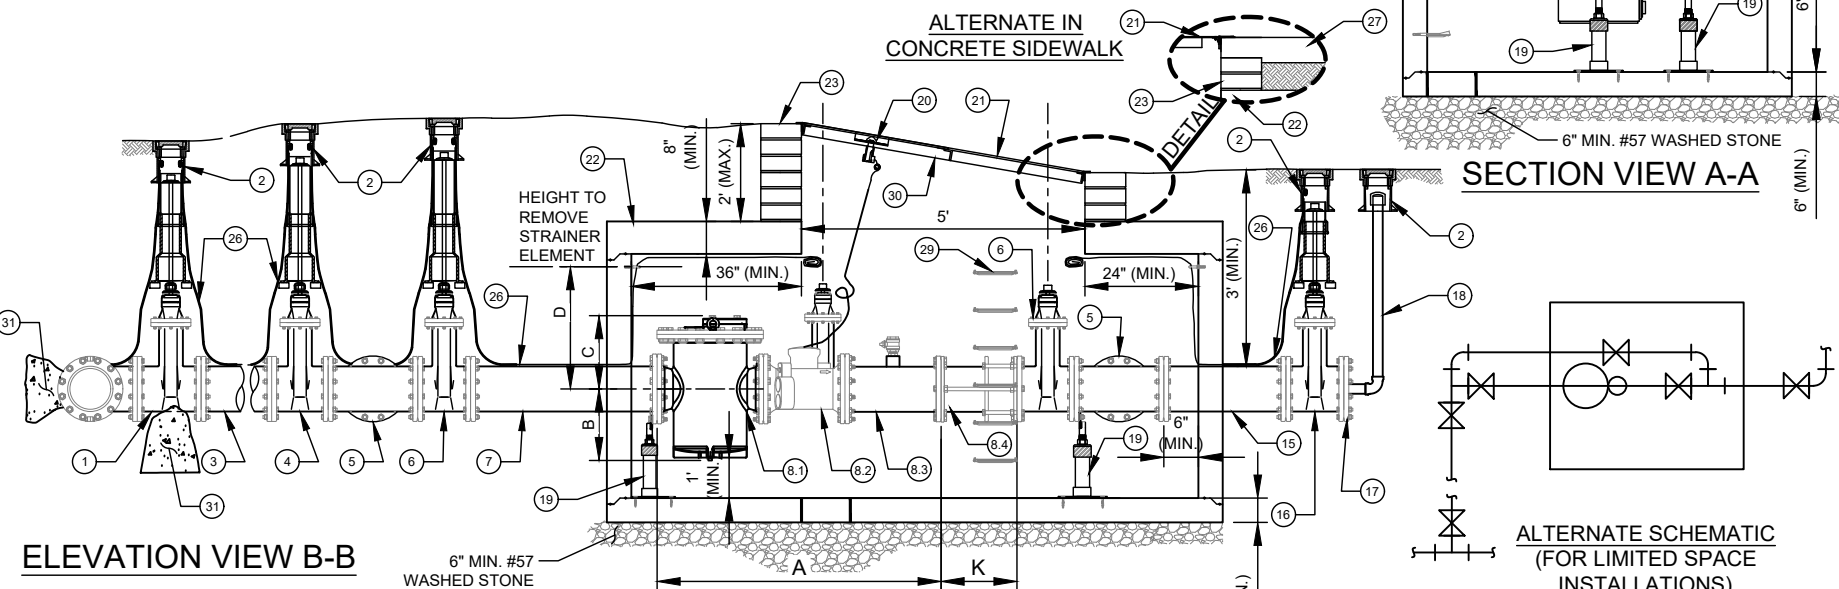

ELEVATION VIEW B-B

METER SIZE	A	B	C	D	K
10"	51.75"	16.2"	14.2"	49.6"	SMITH-BLAIR = 10" ROMAC = 10.5"

NO SCALE

VERSION 1.0

DATE 04/2024

DETAIL 15.55