



SIDEWALK ADJACENT TO HEAD-IN OR BACK-IN PARKING SHALL BE AT LEAST 7 FEET WIDE.

PARKING ON ONE SIDE OF A SIDEWALK

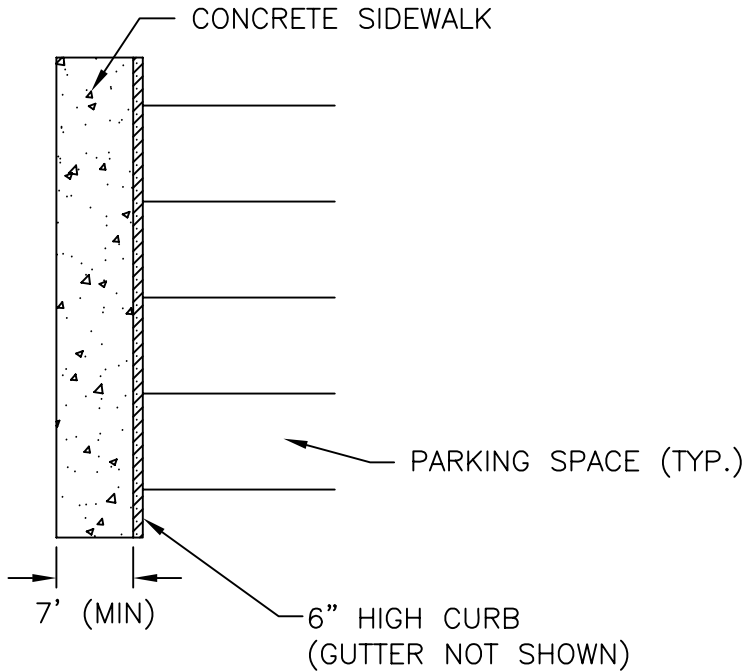

SIDEWALK BETWEEN TWO ROWS OF HEAD-IN OR BACK-IN PARKING SHALL BE AT LEAST 9 FEET WIDE.

PARKING ON BOTH SIDES OF A SIDEWALK

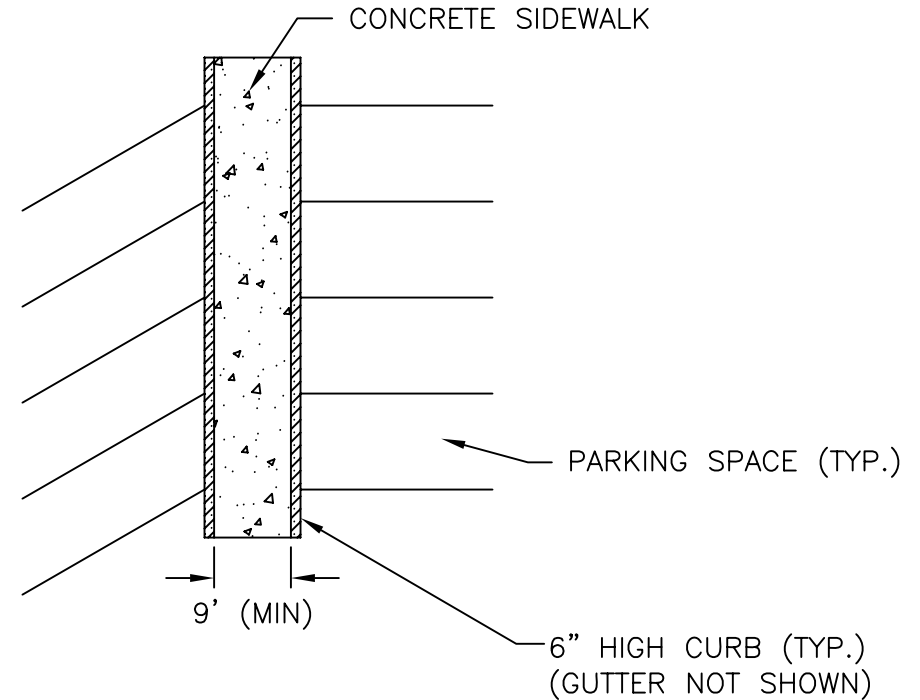

NOTES:

1. A 2-FOOT-WIDE PLANTING STRIP LOCATED AT THE BACK OF CURB CAN BE USED IN LIEU OF 2 FEET OF SIDEWALK WIDTH.
2. PARKING AT ANY ANGLE OTHER THAN PARALLEL SHALL BE SUBJECT TO THIS STANDARD.
3. IF MONOLITHIC CURB & SIDEWALK IS USED, ADD 6" TO ALL DIMENSIONS (1' IF PARKING ON BOTH SIDES).
4. WHEELSTOPS SHALL ONLY BE USED IN LIEU OF 2 FEET OF SIDEWALK WITH THE APPROVAL OF THE CITY AND WHEN EXISTING CONDITIONS PREVENT CONSTRUCTION OF A 7-FOOT/9-FOOT SIDEWALK. WHEELSTOPS SHALL BE 6" HIGH, MADE OUT OF 3600-PSI REINFORCED CONCRETE, AND ANCHORED WITH #5 OR GREATER REBAR (2' MINIMUM LENGTH). REBAR HOLES SHALL BE GROUTED UPON INSTALLATION. WHEELSTOPS SHALL BE PLACED AT 2 FEET FROM THE EDGE OF SIDEWALK OR OBSTRUCTION.

NOT TO SCALE



CITY OF CHARLOTTE  
 LAND DEVELOPMENT STANDARDS  
 INCLUDES CHARLOTTE ETJ

PARKING STANDARDS (CONTINUED)

STD. NO.	REV.
50.09B	1